



Test Report: LRS-350-12

350W Single Output Switching Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST


ENVIRONMENT TEST

DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-------------------------------|-------------------|---|--|
| 1 | OUTPUT VOLTAGE ADJUST RANGE | CH1: 10.2V~ 13.8V | I/P: 230 VAC I/P: 115 VAC O/P: MIN LOAD Ta: 25°C | 9.609V~14.140V/230VAC 9.605V~14.151V/115VAC |
| 2 | OUTPUT VOLTAGE(Max) TOLERANCE | V1: -1.5%~ 1.5% | I/P: 100VAC /264VAC O/P:FULL/ MIN. LOAD Ta:25°C | V1:- 0.08%~ 0.08% |
| 3 | LINE REGULATION (Max) | V1: -0.5%~ 0.5% | I/P: 100VAC~ 264VAC O/P:FULL LOAD Ta:25°C | V1: -0.04%~-0.04% |
| 4 | LOAD REGULATION(Max) | V1: -1%~ 1% | I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C | V1:-0.%~ 0% |
| 5 | OVER/UNDERSHOOT TEST | < ±5% | I/P: 230VAC O/P:FULL LOAD Ta:25°C | <5% |
| 6 | RIPPLE & NOISE(Max) | V1: 150mVp-p | I/P:230VAC O/P:FULL LOAD Ta:25°C | V1: 123mVp-p |

high frequency :

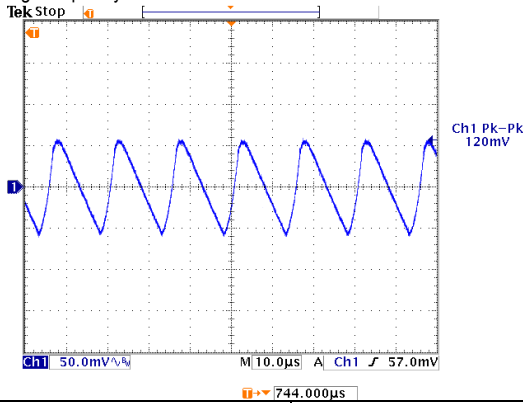


low frequency :

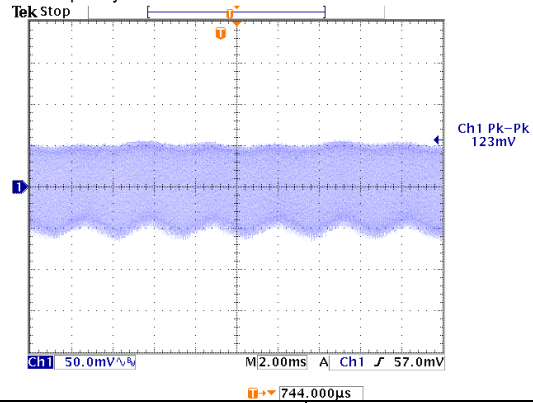

| | | | | |
|---|------------------|---------------------------------|--|----------------------------------|
| 7 | SET UP TIME(Max) | 230VAC/1300ms 115VAC/ 1300ms | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | 230VAC/ 1028ms 115VAC/ 1032ms |
|---|------------------|---------------------------------|--|----------------------------------|


INPUT=230VAC/50HZ @ FULL LOAD

CH1 : Output Voltage CH4 : AC Input Voltage

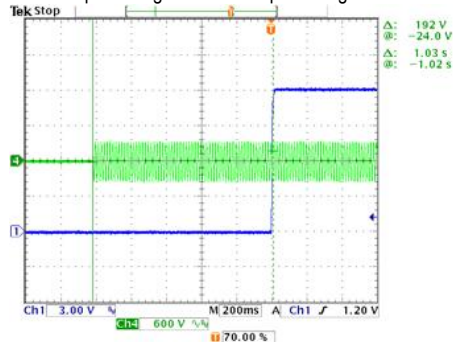

INPUT=115VAC/60HZ @ FULL LOAD







CH1 : Output Voltage CH4 : AC Input Voltage

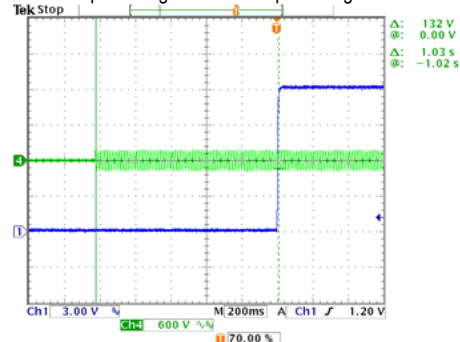



350W Single Output Switching Power Supply

LRS-350series

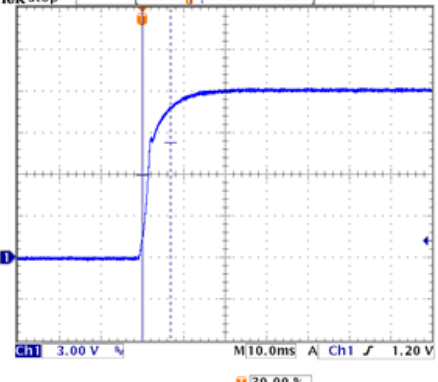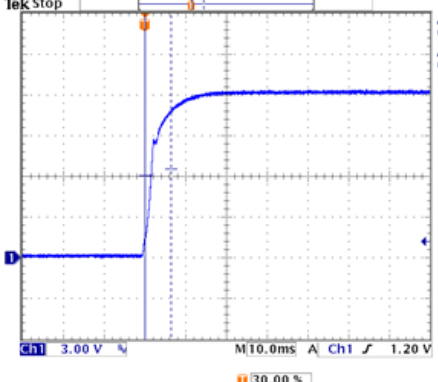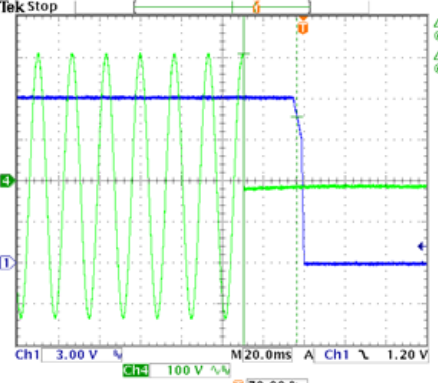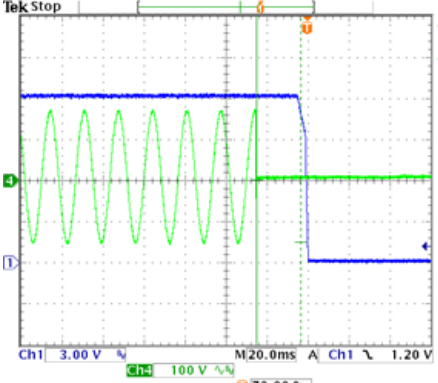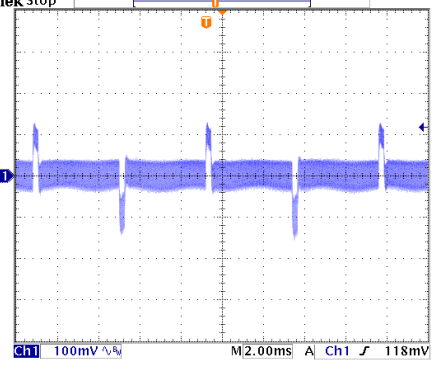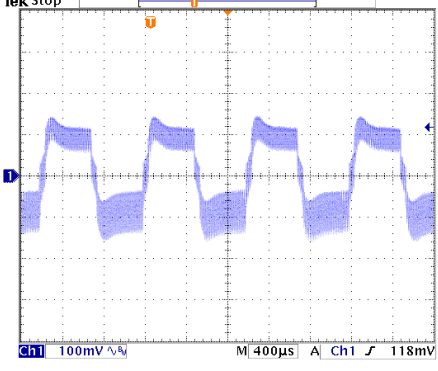
| | | | | |
|---|--------------------|--|---|---------------------------------|
| 8 | RISE TIME (Max) | 230VAC/ 50ms 115VAC/ 50ms | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | 230VAC/ 6.80ms 115VAC/6.40ms |
| INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage  | | INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage  | | |
| 9 | HOLD UP TIME(Typ) | 230VAC/ 16ms 115VAC/ 12ms | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | 230VAC/26.0ms 115VAC/ 21.6ms |
| INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH4 : AC Input Voltage  | | INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH4 : AC Input Voltage  | | |
| 10 | DYNAMIC LOAD | V1: 1200mVp-p | I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C | 274mVp-p 304mVp-p |
| FULL /50% LOAD 50%DUTY / 120HZ  | | FULL /50% LOAD 50%DUTY / 1KHZ  | | |

INPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------|--------------------------------------|--|--------------------------------------|
| 1 | INPUT VOLTAGE RANGE | 180VAC~264VAC | I/P:TESTING O/P:FULL LOAD Ta:25°C | 149V~264V |
| | | | I/P: (1)LOW-LINE-3V=167 V HIGH-LINE+15%=300 V O/P:FULL/MIN LOAD ON: 30 Sec OFF: 30 Sec 10MIN (2)230Vac ON: 0.5 Sec OFF: 0.5 Sec 20MIN (3)230Vac ON:3Sec OFF:3Sec 12HOURS (POWER ON/OFF NO DAMAGE) | TEST:OK |
| 2 | INPUT FREQUENCY RANGE | 47HZ ~63 HZ NO DAMAGE | I/P:170 VAC ~264 VAC O/P:FULL~MIN LOAD Ta:25°C | TEST: OK |
| 3 | INPUT CURRENT (Typ) | 230V/ 3.4.A 115V/ 6.8A | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | I =3.41A/ 230VAC I =6.25A/ 115VAC |
| 4 | LEAKAGE CURRENT | < 2 mA / 240 VAC | I/P: 240 VAC O/P: Min LOAD Ta: 25°C | L-FG: 0.481mA N-FG: 0.481mA |
| 5 | NO LOAD CONSUMPTION | < 0.75 W | I/P: 115VAC I/P: 230VAC O/P: NO LOAD Ta: 25°C | < 0.55W < 0.60 W |
| 6 | INRUSH CURRENT(Typ) | 230V/ 60A 115V/ 60A COLD START | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | I =49.2A/ 230VAC I =36.0A/ 115VAC |


INPUT=230VAC/50HZ @ FULL LOAD

CH2 : Input current (1V=1A) CH4 : AC Input Voltage

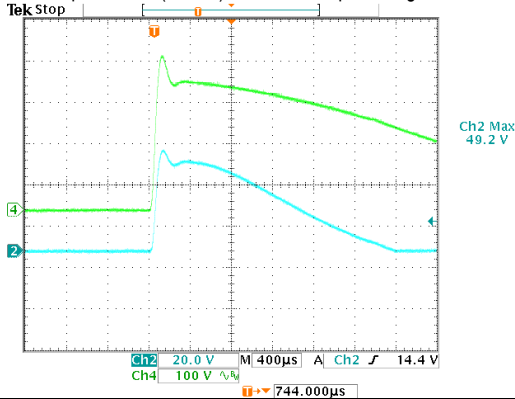

INPUT=115VAC/50HZ @ FULL LOAD


CH2 : Input current (1V=1A) CH4 : AC Input Voltage

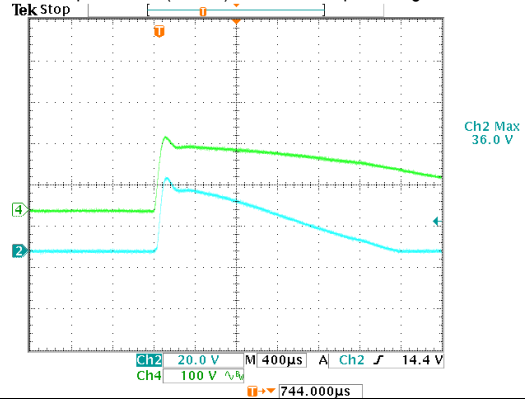



350W Single Output Switching Power Supply

LRS-350series

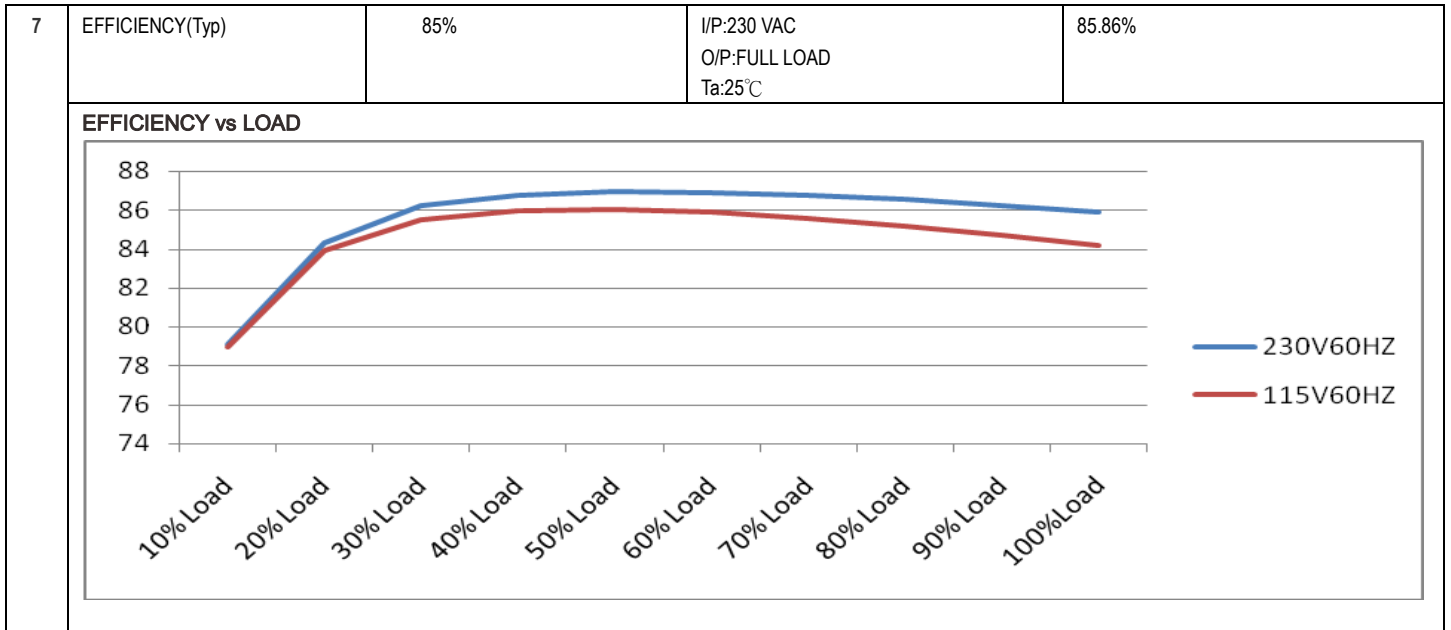

PROTECTION FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------------|--|--|---|
| 1 | OVER LOAD PROTECTION | 110 %~ 140 % | I/P: 230VAC I/P: 115VAC O/P: TESTING Ta:25°C | 122.07%/ 230VAC 121.86%/115VAC Hiccup mode, recovers automatically after fault condition is removed |
| 2 | OVER VOLTAGE PROTECTION | CH: 13.8V~16.2 V | I/P: 230VAC I/P: 115VAC O/P: MIN LOAD Ta:25°C | 15.1V/ 230VAC 15.0V/115VAC Hiccup mode, recovers automatically after fault condition is removed |
| 3 | OVER TEMPERATURE PROTECTION | NO DAMAGE | I/P: 230 VAC O/P: FULL LOAD | O.T.P. Active Hiccup mode, recovers automatically after fault condition is removed |
| 4 | SHORT PROTECTION | SHORT EVERY OUTPUT 1 HOUR NO DAMAGE | I/P: 264VAC O/P: FULL LOAD Ta:25°C | NO DAMAGE Hiccup mode, recovers automatically after fault condition is removed |

COMPONENT STRESS TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|---|---|---|---|
| 1 | PWM Transistor (D to S) or (C to E) Peak Voltage | Q 1 Rated 13A/500V | I/P:High-Line +3V =267V O/P: (1)Full Load Turn on (2)Output Short (3)Full Load Continue Ta:25°C | (1)468V (2)484V (3)446V |
| 2 | Diode Peak Voltage | Q102 Rated 20 A/120V Q103 Rated 20A/120V | I/P:High-Line +3V =267 V O/P: (1)Full Load input on/off (2)Output Short (3)Full Load Continue Ta:25°C | Q102 (1)94.8V (2)89.2V (3)82.0V Q103: (1)87.2V (2)80.0V (3)81.2V |
| 3 | Input Capacitor Voltage | C5 Rated: 560 μ / 200V | I/P:High-Line +3V =267 V O/P: (1)Full Load input on/off (2) MinLoad input on /Off (3)Full Load /Min load Change Ta:25°C | (1)194V (2)183V (3)194V |
| 4 | Control IC Voltage Test | PWM IC U1 Rated 28 V (MAX.) 10V (MIN.) | I/P:High-Line +3V =267 V O/P: (1)Full Load input on/off (2)Min Load input on/off (3)Full Load/Min load change Ta:25°C | U1 (1) 19.6V (2) 19.4V (3) 19.6V |

SAFETY TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|----------------------|---|---|--|
| 1 | WITHSTAND VOLTAGE | I/P-O/P: 3KVAC/min I/P-FG :2KVAC/min O/P-FG:0.5KVAC/min | I/P-O/P: 3.6 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:0.6 KVAC/min Ta:25°C | I/P-O/P: 2. 435mA I/P-FG: 3. 34mA O/P-FG: 2. 74mA NO DAMAGE |
| 2 | ISOLATION RESISTANCE | I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ | I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C | I/P-O/P: 9999MΩ I/P-FG: 9999MΩ O/P-FG: 9999MΩ NO DAMAGE |
| 3 | GROUNDING CONTINUITY | FG(PE) TO CHASSIS OR TRACE < 100 mΩ | 40A / 2min Ta:25°C | 23 mΩ |

E.M.C TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------|--|---|------------|
| 1 | E.S.D | EN61000-4-2 INDUSTRY AIR:8KV / Contact:4KV | I/P: 230 VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |
| 2 | E.F.T | EN61000-4-4 INDUSTRY INPUT: 2KV | I/P: 230VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |



350W Single Output Switching Power Supply

LRS-350series

| | | | | |
|---|---|--|--|------------|
| 3 | SURGE | IEC61000-4-5 INDUSTRY L-N :2KV L,N-PE:4KV | I/P: 230VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |
| 4 | Test by certified Lab & Test Report Prepare | | | |

RELIABILITY TEST

ENVIRONMENT TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----|---|--|--|--|----|----------|--------------------------|-------------------------|---|-----|--------|--------|---|------|--------|---------|---|------|--------|--------|---|----|--------|---------|---|-----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|----|------|--------|--------|----|------|--------|--------|----|------|--------|--------|----|----|--------|--------|----|------|--------|--------|----|-----|--------|--------|----|-----|--------|--------|----|------|--------|--------|
| 1 | TEMPERATURE RISE TEST | MODEL: LRS-350-5 1. ROOM AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=23.5°C 2. HIGH AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=52.9°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | <table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 23.5 °C</th> <th>HIGH AMBIENT Ta=52.9 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF1</td><td>41.5°C</td><td>72.0°C</td></tr> <tr><td>2</td><td>L100</td><td>74.7°C</td><td>113.3°C</td></tr> <tr><td>3</td><td>C105</td><td>57.2°C</td><td>90.9°C</td></tr> <tr><td>4</td><td>T1</td><td>68.6°C</td><td>103.0°C</td></tr> <tr><td>5</td><td>BD1</td><td>42.3°C</td><td>71.0°C</td></tr> <tr><td>6</td><td>C5</td><td>35.7°C</td><td>62.7°C</td></tr> <tr><td>7</td><td>T2</td><td>29.6°C</td><td>57.8°C</td></tr> <tr><td>8</td><td>Q2</td><td>42.9°C</td><td>74.9°C</td></tr> <tr><td>9</td><td>Q1</td><td>41.5°C</td><td>73.0°C</td></tr> <tr><td>10</td><td>Q103</td><td>58.3°C</td><td>90.3°C</td></tr> <tr><td>11</td><td>Q102</td><td>59.4°C</td><td>92.4°C</td></tr> <tr><td>12</td><td>Q104</td><td>57.1°C</td><td>88.7°C</td></tr> <tr><td>13</td><td>U1</td><td>29.9°C</td><td>58.6°C</td></tr> <tr><td>14</td><td>U100</td><td>60.1°C</td><td>91.5°C</td></tr> <tr><td>15</td><td>D10</td><td>35.7°C</td><td>65.1°C</td></tr> <tr><td>16</td><td>C36</td><td>27.5°C</td><td>56.3°C</td></tr> <tr><td>17</td><td>RTH3</td><td>50.9°C</td><td>80.3°C</td></tr> </tbody> </table> | NO | Position | ROOM AMBIENT Ta= 23.5 °C | HIGH AMBIENT Ta=52.9 °C | 1 | LF1 | 41.5°C | 72.0°C | 2 | L100 | 74.7°C | 113.3°C | 3 | C105 | 57.2°C | 90.9°C | 4 | T1 | 68.6°C | 103.0°C | 5 | BD1 | 42.3°C | 71.0°C | 6 | C5 | 35.7°C | 62.7°C | 7 | T2 | 29.6°C | 57.8°C | 8 | Q2 | 42.9°C | 74.9°C | 9 | Q1 | 41.5°C | 73.0°C | 10 | Q103 | 58.3°C | 90.3°C | 11 | Q102 | 59.4°C | 92.4°C | 12 | Q104 | 57.1°C | 88.7°C | 13 | U1 | 29.9°C | 58.6°C | 14 | U100 | 60.1°C | 91.5°C | 15 | D10 | 35.7°C | 65.1°C | 16 | C36 | 27.5°C | 56.3°C | 17 | RTH3 | 50.9°C | 80.3°C |
| NO | Position | ROOM AMBIENT Ta= 23.5 °C | HIGH AMBIENT Ta=52.9 °C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | LF1 | 41.5°C | 72.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | L100 | 74.7°C | 113.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | C105 | 57.2°C | 90.9°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | T1 | 68.6°C | 103.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | BD1 | 42.3°C | 71.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | C5 | 35.7°C | 62.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | T2 | 29.6°C | 57.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | Q2 | 42.9°C | 74.9°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | Q1 | 41.5°C | 73.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | Q103 | 58.3°C | 90.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 | Q102 | 59.4°C | 92.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 | Q104 | 57.1°C | 88.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 13 | U1 | 29.9°C | 58.6°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 | U100 | 60.1°C | 91.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 15 | D10 | 35.7°C | 65.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16 | C36 | 27.5°C | 56.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 17 | RTH3 | 50.9°C | 80.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | OVER LOAD BURN-IN TEST | NO DAMAGE 1 HOUR (MIN) | I/P: 230 VAC O/P: 113 % LOAD Ta: 25°C | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | LOW TEMPERATURE TURN ON TEST | TURN ON AFTER 2 HOUR | I/P: 264VAC/100VAC O/P: 100 % LOAD Ta= -25 °C | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST | AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C NO DAMAGE | I/P: 272 VAC O/P: FULL LOAD Ta= 50 °C HUMIDITY= 95 %R.H | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | TEMPERATURE COEFFICIENT | ± 0.03 %/°C (0~50°C) | I/P: 230 VAC O/P: FULL LOAD | ±0%/°C (0~50°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | STORAGE TEMPERATURE TEST | 1. Thermal shock Temperature : -45°C ~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC | | OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |



350W Single Output Switching Power Supply

LRS-350series

| | | | |
|----|-----------------------------|--|---|
| 7 | THERMAL SHOCK TEST | 1. Thermal shock Temperature : -25°C ~ 70°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 230VAC/Full Load AC ON/OFF TEST turn on 58sec ; turn off 2sec | OK |
| 8 | VIBRATION TEST | 1 Carton & 1 Set (1) Waveform: Sine Wave (2) Frequency: 10~500Hz (3) Sweep Time: 10min/sweep cycle (4) Acceleration: 5G (5) Test Time: 60min in each axis (X.Y.Z) (6) Ta: 25°C | TEST: OK |
| 9 | CAPACITOR LIFE CYCLE | SUPPOSE C105 IS THE MOST CRITICAL COMPONENT (1) I/P: 230VAC O/P: FULL LOAD Ta= 25 °C LIFE TIME (2) I/P: 230VAC O/P: FULL LOAD Ta= 50 °C LIFE TIME (3) I/P: 230VAC O/P: 75% LOAD Ta= 50 °C LIFE TIME (4) I/P: 230VAC O/P: 50% LOAD Ta= 50 °C LIFE TIME | (1) 276816HRS (2) 36335HRS (3) 108557HRS (4) 220246HRS |
| 10 | MTBF | MIL-HDBK-217F TOTAL FAILURE RATE: 327.9KHRS | |
| 11 | DMTBF/Accelerated Life Test | Demonstration Mean Time Between Failure (Expected Life): Above 30,000 hours @ TA 50°C | |

| TEST RESULT | TESTER | APPROVAL |
|-------------|--------|------------|
| PASS | FRANK | WANGDEZHAO |