



Test Report: LRS-75-5

75W Single Output Switching Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST


Safety Test

E.M.C. Test

■ RELIABILITY TEST

ENVIRONMENT TEST

| | | | |
|--|--|--|---|
| | <p>Δ: 252 V @: 24.0 V Δ: 222ms @: 0.00 s</p> | | <p>Δ: 136 V @: 0.00 V Δ: 212ms @: -208ms</p> |
| <p>8 RISE TIME (Max)</p> | <p>230VAC/ 30 ms 115VAC/ 30 ms</p> | <p>I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C</p> | <p>230VAC/ 7.6 ms 115VAC/ 7.6 ms</p> |
| <p>INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage</p> | <p>INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage</p> | | |
| | <p>Δ: 3.08 V @: 4.04 V Δ: 7.60ms @: 0.00 s</p> | | <p>Δ: 3.94 V @: 540mV Δ: 7.60ms @: 0.00 s</p> |
| <p>9 HOLD UP TIME (Typ.)</p> | <p>230VAC/ 60 ms 115VAC/ 12 ms</p> | <p>I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C</p> | <p>230VAC/ 83.2 ms 115VAC/ 16.8 ms</p> |
| <p>INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> | <p>INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> | | |

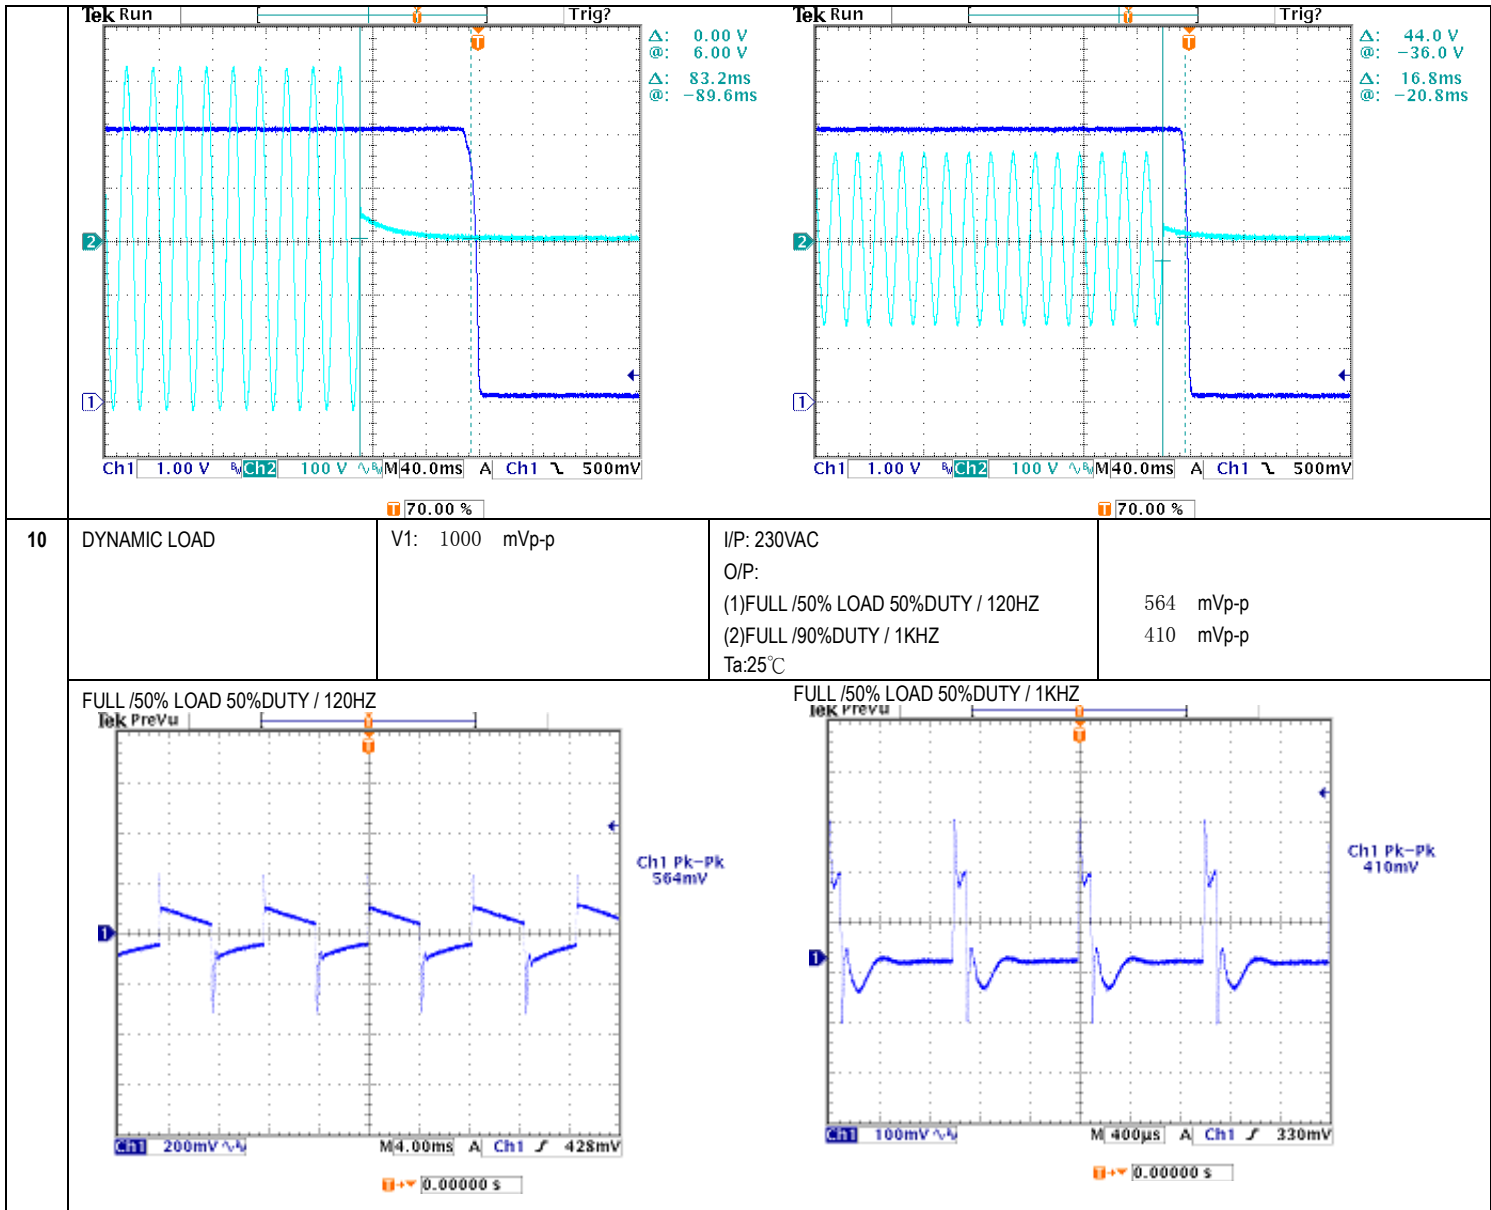


INPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------|--------------------------|---|-----------|
| 1 | INPUT VOLTAGE RANGE | 85VAC~264VAC | I/P: TESTING O/P: FULL LOAD Ta:25°C | 63 V~264V |
| | | | I/P: LOW-LINE-3V=82V HIGH-LINE+15%=300 V O/P: FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE) | TEST: OK |
| 2 | INPUT FREQUENCY RANGE | 47HZ ~63 HZ NO DAMAGE | I/P: 100 VAC ~264 VAC O/P: FULL ~MIN LOAD Ta:25°C | TEST: OK |


| | | | | |
|---|----------------------|-----------------------------|--|--|
| 3 | INPUT CURRENT (Typ.) | 230V/ 0.85 A 115V/ 1.4 A | I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C | I = 0.598 A/ 230VAC I = 1.225 A/ 115VAC |
| 4 | LEAKAGE CURRENT | < 0.75mA / 240 VAC | I/P : 240 VAC O/P : Min LOAD Ta : 25°C | L-FG : 0.381 mA N-FG : 0.381 mA |
| 5 | NO LOAD CONSUMPTION | < 0.3W | I/P : 115VAC I/P : 230VAC O/P : NO LOAD Ta : 25°C | < 0.092 W < 0.2315 W |
| 6 | EFFICIENCY(Typ.) | 86.5% | I/P:230 VAC O/P:FULL LOAD Ta:25°C | 87.51% |

EFFICIENCY vs LOAD

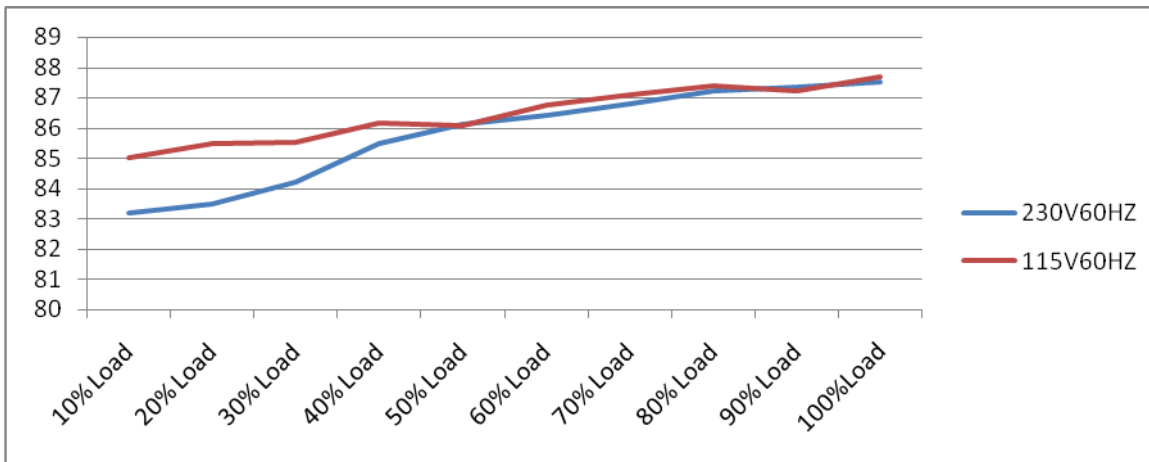

| | | | | |
|---|----------------------|------------------------------|---|--------------------|
| 8 | INRUSH CURRENT(Typ.) | 230V/ 50 A COLD START | I/P : 230 VAC O/P : FULL LOAD Ta : 25°C | I = 47.8 A/ 230VAC |
|---|----------------------|------------------------------|---|--------------------|

INPUT=230VAC/50HZ @ FULL LOAD
CH2 : AC Input Voltage CH4 : Input current (1V=1A)

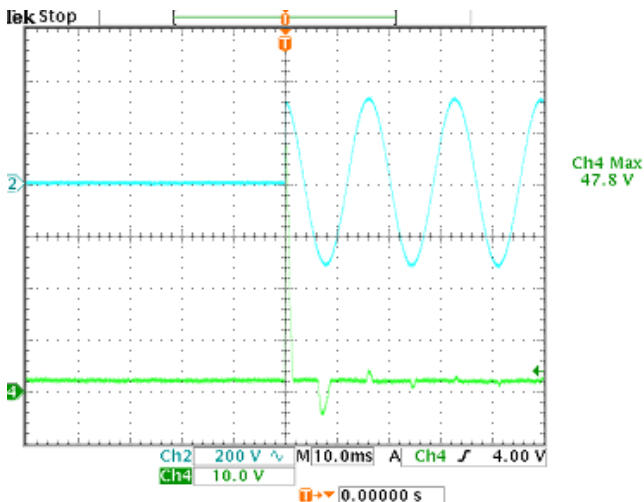

PROTECTION FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-------------------------|--|---|---|
| 1 | OVER LOAD PROTECTION | 110 %~ 150 % | I/P: 264VAC I/P: 230VAC I/P: 100VAC O/P: TESTING Ta: 25°C | 129.0%/ 264VAC 128.42%/ 230VAC 120.5%/100VAC PROTECTION TYPE : Hiccup mode, recovers automatically after fault condition is removed |
| 2 | OVER VOLTAGE PROTECTION | 5. 75V~ 6.75 V | I/P: 264VAC I/P: 230VAC I/P: 90VAC O/P: MIN LOAD Ta: 25°C | 6.28V/ 264VAC 6.26V/ 230VAC 6.24V/ 90VAC PROTECTION TYPE : shut down o/p voltage, re-power on to recover |
| 3 | SHORT PROTECTION | SHORT EVERY OUTPUT 1 HOUR NO DAMAGE | I/P: 264VAC I/P: 90VAC O/P: FULL LOAD Ta: 25°C | NO DAMAGE PROTECTION TYPE : Hiccup mode, recovers automatically after fault condition is removed |

COMPONENT STRESS TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|--|--|--|---|
| 1 | PWM Transistor (D to S) or (C to E) Peak Voltage | Q1 Rated : 11A/ 600V | I/P: High-Line +3V =267V AC ON/OFF VDS: O/P: (1) Full Load (2) Output Short (3) Full load continue Ta: 25°C | VDS: (1) 538V (2) 596V (3) 530V |
| 2 | Diode Peak Voltage | Q100 Rated : 110A/ 60V | I/P: High-Line +3V =267 V AC ON/OFF O/P: (1) Full Load (2) Output Short (3) Full load continue Ta: 25°C | Q100: VDS: (1) 53.7V (2) 54.8V (3) 49.2V |
| 3 | Input Capacitor Voltage | C5 Rated: : 150 μ / 400 V 105 °C | I/P: High-Line +3V =267 V O/P: (1) Full Load input on/off (2) Min load input on /Off (3) Full Load /Min load Change Ta: 25°C | (1) 352V (2) 356V (3) 366V |
| 4 | Control IC Voltage Test | PWM IC U1 Rated : 28V 9.5V(MIN.) | I/P: High-Line +3V =267 V AC ON/OFF O/P(1) FULL LOAD (2) Output Short (3) O.L.P (4) O.V.P. (5) NO LOAD VR MIN .LOW LINE Ta: 25°C | (1) 21.8V (2) 20.1V (3) 19.5V (4) 17.5V (5) 12.0V |

SAFETY TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|----------------------|---|---|--|
| 1 | WITHSTAND VOLTAGE | I/P-O/P: 3.75KVAC/min I/P-FG :2KVAC/min O/P-FG:1.25KVAC/min | I/P-O/P: 4. 5 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:1. 5 KVAC/min Ta:25°C | I/P-O/P: 2. 352 mA I/P-FG: 2. 85 mA O/P-FG: 2. 243 mA NO DAMAGE |
| 2 | ISOLATION RESISTANCE | I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ | I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C | I/P-O/P:>9999 MΩ I/P-FG: >9999MΩ O/P-FG: >9999MΩ NO DAMAGE |
| 3 | GROUNDING CONTINUITY | FG(PE) TO CHASSIS OR TRACE < 100 mΩ | 40A / 2min Ta:25°C | 26mΩ |

E.M.C TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|---|---|--|-------------------------------|
| 1 | HARMONIC | EN61000-3-2 CLASS A | I/P:230VAC/50HZ O/P:FULL LOAD Ta:25°C | PASS |
| 2 | CONDUCTION | EN55022 CLASS B | I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C | PASS Test by certified Lab |
| 3 | RADIATION | EN55022 CLASS B | I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C | PASS Test by certified Lab |
| 4 | E.S.D | EN61000-4-2 INDUSTRY AIR : 8KV / Contact : 4KV | I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C | CRITERIA A |
| 5 | E.F.T | EN61000-4-4 INDUSTRY INPUT : 2KV | I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C | CRITERIA A |
| 6 | SURGE | IEC61000-4-5 INDUSTRY L-N : 2KV L,N-PE : 4KV | I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C | CRITERIA A |
| 7 | Test by certified Lab & Test Report Prepare | | | |

■ **RELIABILITY TEST**

ENVIRONMENT TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----|---|--|--|---|----|----------|------------------------|------------------------|---|-----|--------|--------|---|-----|--------|--------|---|----|--------|--------|---|----|--------|---------|---|----|--------|--------|---|-----|--------|--------|---|----|--------|--------|---|------|--------|--------|---|------|--------|--------|----|------|--------|--------|----|------|--------|--------|----|------|--------|---------|----|------|--------|--------|----|-----|--------|--------|----|------|--------|--------|
| 1 | TEMPERATURE RISE TEST | MODEL : LRS-75-5 1. ROOM AMBIENT BURN-IN : 2HRS I/P : 230VAC O/P : FULL LOAD Ta=31.3°C 2. HIGH AMBIENT BURN-IN : 2HRS I/P : 230VAC O/P : FULL LOAD Ta=42.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | <table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=31.3°C</th> <th>HIGH AMBIENT Ta=42.5°C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF1</td><td>57.2°C</td><td>67.1°C</td></tr> <tr><td>2</td><td>BD1</td><td>65.1°C</td><td>74.6°C</td></tr> <tr><td>3</td><td>C5</td><td>63.2°C</td><td>72.6°C</td></tr> <tr><td>4</td><td>D5</td><td>93.1°C</td><td>104.0°C</td></tr> <tr><td>5</td><td>Q1</td><td>84.2°C</td><td>95.8°C</td></tr> <tr><td>6</td><td>C35</td><td>75.3°C</td><td>86.4°C</td></tr> <tr><td>7</td><td>T1</td><td>81.6°C</td><td>91.9°C</td></tr> <tr><td>8</td><td>C106</td><td>81.9°C</td><td>91.4°C</td></tr> <tr><td>9</td><td>C110</td><td>69.0°C</td><td>80.3°C</td></tr> <tr><td>10</td><td>L100</td><td>77.1°C</td><td>89.0°C</td></tr> <tr><td>11</td><td>C107</td><td>76.8°C</td><td>89.3°C</td></tr> <tr><td>12</td><td>Q100</td><td>89.8°C</td><td>103.4°C</td></tr> <tr><td>13</td><td>U100</td><td>77.4°C</td><td>87.1°C</td></tr> <tr><td>14</td><td>D30</td><td>84.9°C</td><td>95.3°C</td></tr> <tr><td>15</td><td>D200</td><td>89.5°C</td><td>99.2°C</td></tr> </tbody> </table> | NO | Position | ROOM AMBIENT Ta=31.3°C | HIGH AMBIENT Ta=42.5°C | 1 | LF1 | 57.2°C | 67.1°C | 2 | BD1 | 65.1°C | 74.6°C | 3 | C5 | 63.2°C | 72.6°C | 4 | D5 | 93.1°C | 104.0°C | 5 | Q1 | 84.2°C | 95.8°C | 6 | C35 | 75.3°C | 86.4°C | 7 | T1 | 81.6°C | 91.9°C | 8 | C106 | 81.9°C | 91.4°C | 9 | C110 | 69.0°C | 80.3°C | 10 | L100 | 77.1°C | 89.0°C | 11 | C107 | 76.8°C | 89.3°C | 12 | Q100 | 89.8°C | 103.4°C | 13 | U100 | 77.4°C | 87.1°C | 14 | D30 | 84.9°C | 95.3°C | 15 | D200 | 89.5°C | 99.2°C |
| NO | Position | ROOM AMBIENT Ta=31.3°C | HIGH AMBIENT Ta=42.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | LF1 | 57.2°C | 67.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | BD1 | 65.1°C | 74.6°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | C5 | 63.2°C | 72.6°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | D5 | 93.1°C | 104.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | Q1 | 84.2°C | 95.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | C35 | 75.3°C | 86.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | T1 | 81.6°C | 91.9°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | C106 | 81.9°C | 91.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | C110 | 69.0°C | 80.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | L100 | 77.1°C | 89.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 | C107 | 76.8°C | 89.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 | Q100 | 89.8°C | 103.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 13 | U100 | 77.4°C | 87.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 | D30 | 84.9°C | 95.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 15 | D200 | 89.5°C | 99.2°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | OVER LOAD BURN-IN TEST | NO DAMAGE 1 HOUR (MIN) | I/P : 230 VAC O/P : 120% LOAD Ta : 25°C | TEST : OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | LOW TEMPERATURE TURN ON TEST | TURN ON AFTER 2 HOUR | I/P : 264VAC/100VAC O/P : 100 % LOAD Ta=-30°C | TEST : OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST | AFTER 12 HOURS IN CHAMBER ON CONTROL 40°C NO DAMAGE | I/P : 272 VAC O/P : FULL LOAD Ta=40°C HUMIDITY= 95 %R.H | TEST : OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | TEMPERATURE COEFFICIENT | ± 0.03%/°C (0~50°C) | I/P : 230 VAC O/P : FULL LOAD | ±0.008%/°C (0~50°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | STORAGE TEMPERATURE TEST | 1. Thermal shock Temperature : -40°C~ +85°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC | | OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | THERMAL SHOCK TEST | 1. Thermal shock Temperature : -30°C~ +70°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 230VAC/Full Load AC ON/OFF TEST turn on 58sec ; turn off 2sec | | OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |



| | | | |
|----|-----------------------------|---|--|
| 8 | VIBRATION TEST | 1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 12min/sweep cycle (4) Acceleration : 5G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C | TEST : OK |
| 9 | CAPACITOR LIFE CYCLE | SUPPOSE C106 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta=25°C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta=40°C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta=40°C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta=40°C LIFE TIME | (1) 56064HRS (2) 28119HRS (3) 157680HRS (4) 325360HRS |
| 10 | MTBF | MIL-HDBK-217F TOTAL FAILURE RATE : 681.2 KHRS | |
| 11 | DMTBF/Accelerated Life Test | Demonstration Mean Time Between Failure (Expected Life): Above 50,000 hours @ TA 50°C | |

| TEST RESULT | TESTER | APPROVAL |
|-------------|--------|----------|
| PASS | Frank | WANGDZ |

2007/3/20 A50-S014