



Test Report: NDR-240-48

240W Single Output Industrial DIN RAIL

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test


■ RELIABILITY TEST

ENVIRONMENT TEST


■ DESIGN VERIFY TEST

OUTPUT FUNCTION TEST


NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1: 48V~ 55V	I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C	46.625V~57.687V/230VAC 46.613V~57.685V/115VAC
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1: -1%~ -1%	I/P: 100VAC /264VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1: 0%~ 0%
3	LINE REGULATION (Max)	V1: -0.5%~ -0.5%	I/P: 100VAC~ 264VAC O/P:FULL LOAD Ta:25°C	V1: 0%~ 0%
4	LOAD REGULATION(Max)	V1: -1%~ -1%	I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C	V1: 0%~ 0%
5	OVER/UNDERSHOOT TEST	< ±5%	I/P: 230VAC O/P:FULL LOAD Ta:25°C	< ±5%
6	RIPPLE & NOISE(Max)	V1: 150mVp-p	I/P:230VAC O/P:FULL LOAD Ta:25°C	V1: 39.0mVp-p
<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p>high frequency :</p> </div> <div style="text-align: center;"> <p>low frequency :</p> </div> </div>				
7	SET UP TIME(Max)	230VAC/1500ms 115VAC/3000ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/ 800ms 115VAC/ 872ms
INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage			INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage	

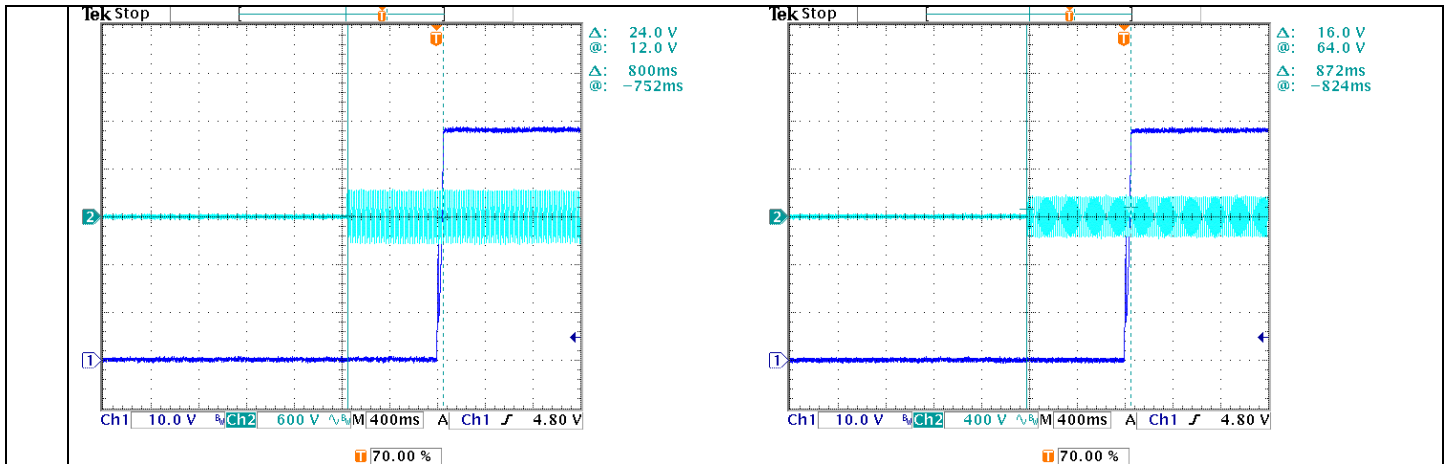

8	RISE TIME (Max)	230VAC/100ms	I/P : 230 VAC	230VAC/ 50.8 ms
		115VAC/100ms	I/P : 115 VAC	115VAC/ 51.2 ms
		O/P : FULL LOAD		
		Ta : 25°C		

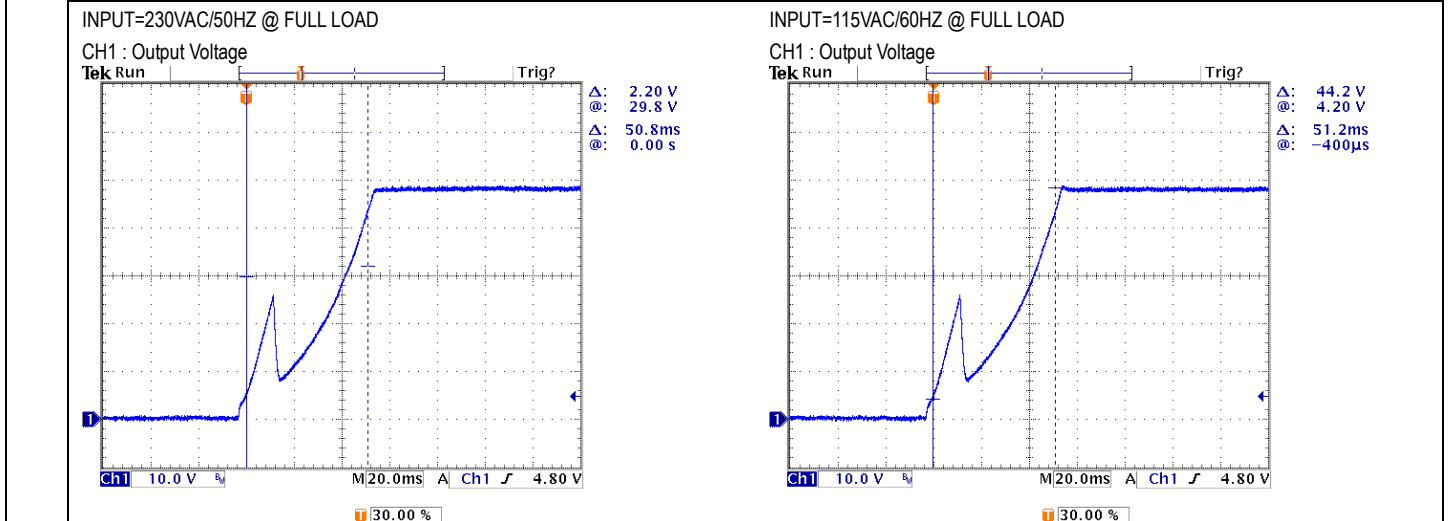


9	HOLD UP TIME (Typ.)	230VAC/28ms	I/P : 230 VAC	230VAC/ 29.8 ms
		115VAC/22ms	I/P : 115 VAC	115VAC/ 24.0 ms
		O/P : FULL LOAD		
		Ta : 25°C		

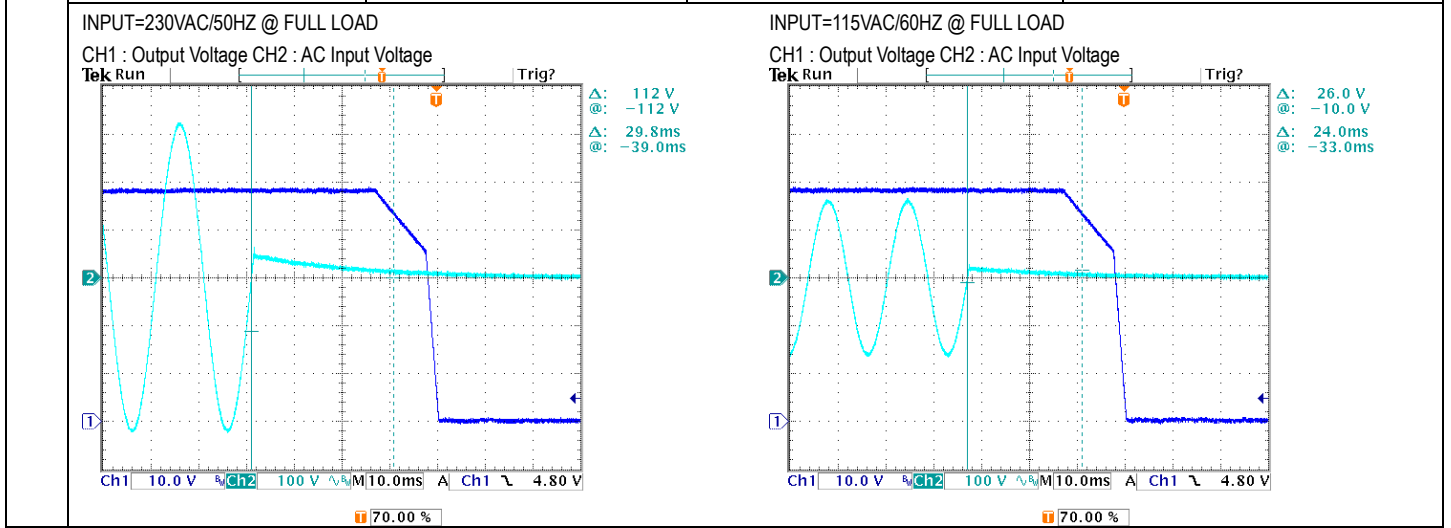

10	DYNAMIC LOAD	V1: 4800mVp-p	I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C	1070mVp-p 646mVp-p
11	TRANSIENT RECOVERY TIME	V1: 4800mVp-p <500us	I/P: 230VAC O/P:40% LOAD CHANGE 50%DUTY/120HZ 1.25A/us	434mVp-p 0us


INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	90VAC~264VAC	I/P:TESTING O/P:FULL LOAD Ta:25°C	84.7V~264V
			I/P: LOW-LINE-3V=87 V HIGH-LINE+15%=300 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:100 VAC ~264 VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT (Typ.)	230V/ 1.3A 115V/ 2.5A	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I=1.18A/ 230VAC I=2.46A/ 115VAC
4	LEAKAGE CURRENT	<1 mA / 240 VAC	I/P : 240 VAC O/P : Min LOAD Ta : 25°C	L-FG : 0.8mA N-FG : 0.8mA
6	POWER FACTOR (Typ.)	0.95/ 230VAC 0.98/115VAC	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	PF=0.975/230VAC PF=0.993/115VAC
	P.F vs LOAD			

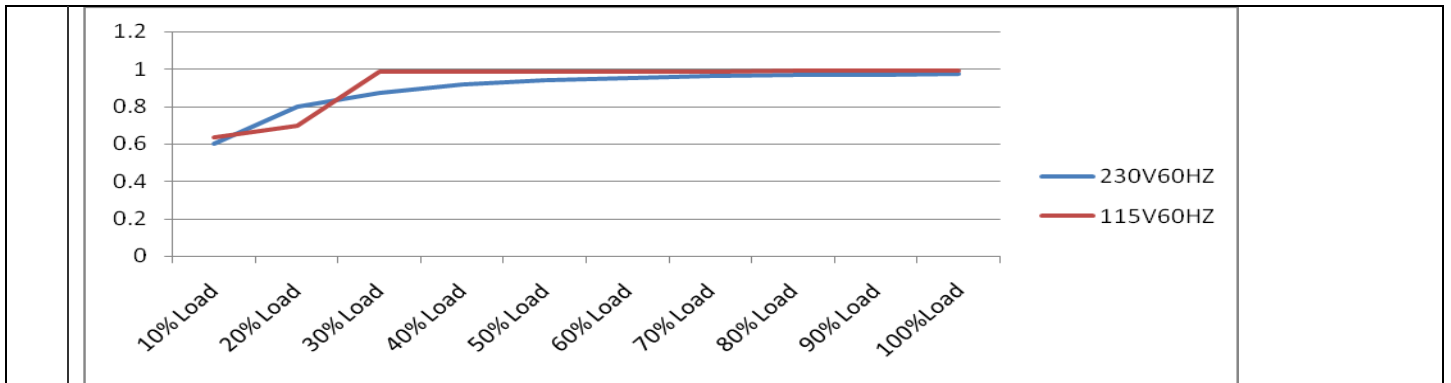

7	EFFICIENCY(Typ.)	89%	I/P:230 VAC O/P:FULL LOAD Ta:25°C	90.8%
---	------------------	-----	---	-------


EFFICIENCY vs LOAD

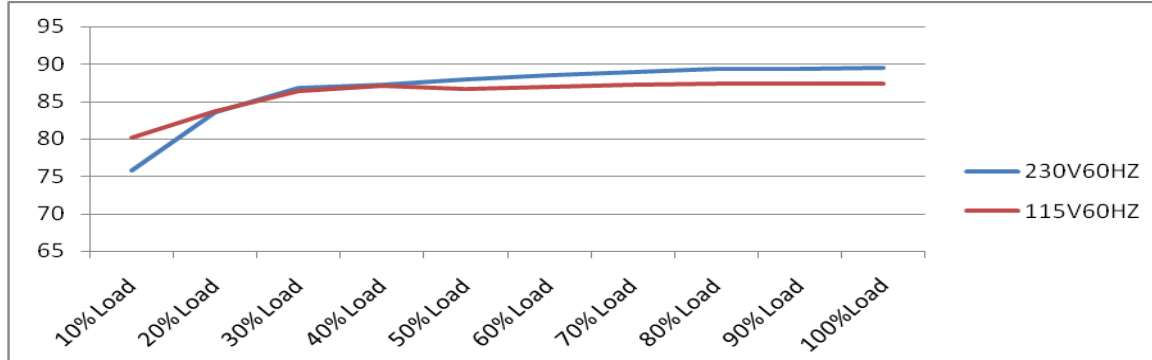

8	INRUSH CURRENT(Typ.)	230V/35A 115V/20A COLD START	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I=30.6A/ 230VAC I=19.6A/ 115VAC
---	----------------------	------------------------------------	--	------------------------------------


INPUT=230VAC/50HZ @ FULL LOAD

CH2 : AC Input Voltage CH4 : Input current (1V=1A)

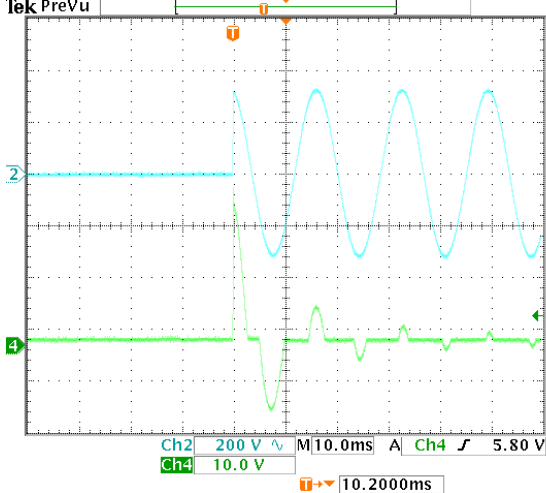

INPUT=115VAC/ 60HZ @ FULL LOAD

CH2 : AC Input Voltage CH4 : Input current (1V=1A)

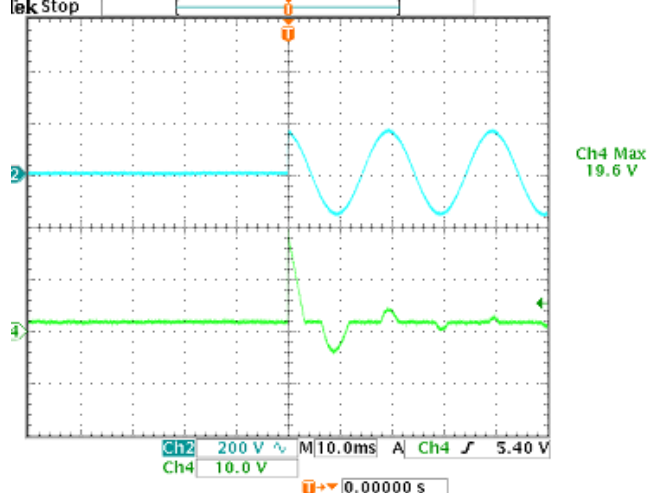

			<p>(2)Output Short (3) Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4) Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (5) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (6)NO LOAD Ta:25°C</p>	(6)12.5V
2	P.F.C Transistor (D to S) or (C to E) Peak Voltage	<p>Q1 Rated : 20 A/ 600 V VGS ± 30V</p>	<p>I/P:High-Line +3V =267 V AC ON/OFF O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (5)0%→400% Load. VGS: (1)OLP (2)Output Short (3) Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4) Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (5) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (6)NO LOAD I/P:Low-Line -3V = 97V AC ON/OFF O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (5)0%→400% Load. VGS: (1)OLP (2)Output Short (3) Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4) Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (5) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (6)NO LOAD Ta:25°C</p>	<p>VDS: (1) 428V (2) 404V (3) 430V (4) 415V (5) 436V VGS: (1)13.6V (2)13.4V (3)13.5V (4)13.5V (5)13.2V (6)10.2V VDS: (1) 436 V (2) 440V (3) 464V (4) 451V (5) 441V VGS: (1)13.4V (2)13.2V (3)13.4V (4)13.7V (5)13.1V (6)12.5V</p>
3	P.F.C DIODE	<p>D10 Rated : 8A/ 600V</p>	<p>I/P:High-Line +3V =267 V AC ON/OFF O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/</p>	<p>(1) 394V (2) 398V (3) 395V (4) 398V</p>

			<p>Min. Load 50%Duty/120Hz I/P:Low-Line -3V = 97V AC ON/OFF O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz Ta:25°C</p>	<p>(1) 362V (2) 374V (3) 374V (4) 372V</p>
4	Diode Peak Voltage	<p>D101 Rated : 10A/ 200V D102 Rated : 20A/ 300 V</p>	<p>I/P:High-Line +3V =267 V AC ON/OFF O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (5)0%→400% Load. Ta:25°C</p>	<p>Q101: VDS: (1)170V (2)165V (3)177V (4)170V (5)165V Q104: VDS: (1)264V (2)284V (3)264V (4)262V (5)284V</p>
5	Input Capacitor Voltage	<p>C5 Rated: : 180μ/ 400 V 105 °C</p>	<p>I/P:High-Line +3V =267 V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change Ta:25°C</p>	<p>(1)386V (2)382V (3)402V</p>
6	Control IC Voltage Test	<p>PWM IC U1 Rated : 27 V 12V(MIN.)</p>	<p>I/P:High-Line +3V =267 V AC ON/OFF O/P(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. (5)NO LOAD VR 下限.LOW LINE Ta:25°C</p>	<p>(1) 15.6V (2) 15.6V (3) 15.6V (4) 15.6V (5) 14.3V</p>
7	Clamp Diode Peak Voltage	<p>D22 Rated : 1KV/ 1 A</p>	<p>I/P : High-Line +3V = 267 V AC ON/OFF O/P : (1) Dynamic Load 90%Duty/1KHz (2)Full load continue Ta : 25°C</p>	<p>(1)772 (2)768</p>

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 3KVAC/min I/P-FG :2KVAC/min O/P-FG:0.5KVAC/min	I/P-O/P: 3.6 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:0.6 KVAC/min Ta:25°C	I/P-O/P:1.5mA I/P-FG:1.3mA O/P-FG:0.5m A NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P:>9999 MΩ I/P-FG: >9999MΩ O/P-FG: >9999MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	3.8 mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:230VAC/50HZ O/P:FULL LOAD Ta:25°C	PASS
<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p>100%</p> </div> <div style="text-align: center;"> <p>75%</p> </div> </div> <div style="text-align: center; margin-top: 20px;"> <p>50%</p> </div>				
2	CONDUCTION	EN55022 CLASS B	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
3	RADIATION	EN55022 CLASS B	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab

4	E.S.D	EN61000-4-2 INDUSTRY AIR : 8KV / Contact : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
5	E.F.T	EN61000-4-4 INDUSTRY INPUT : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
6	SURGE	IEC61000-4-5 INDUSTRY L-N : 2KV L,N-PE : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare			

■ RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																												
1	TEMPERATURE RISE TEST	MODEL : NDR-240-48 1. ROOM AMBIENT BURN-IN : 1 HRS I/P : 230VAC O/P : FULL LOAD Ta= 19.5 °C 2. HIGH AMBIENT BURN-IN : 1 HRS I/P : 230VAC O/P : FULL LOAD Ta= 46.3 °C																																																																														
		<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 19.5 °C</th> <th>HIGH AMBIENT Ta= 46.3 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF1</td><td>32.5°C</td><td>58.7°C</td></tr> <tr><td>2</td><td>LF2</td><td>41.1°C</td><td>67.7°C</td></tr> <tr><td>3</td><td>BD1</td><td>51.3°C</td><td>77.2°C</td></tr> <tr><td>4</td><td>LF3</td><td>47.4°C</td><td>74.3°C</td></tr> <tr><td>5</td><td>C5</td><td>39.1°C</td><td>64.5°C</td></tr> <tr><td>6</td><td>U1</td><td>45.2°C</td><td>71.7°C</td></tr> <tr><td>7</td><td>C105</td><td>48.4°C</td><td>75.6°C</td></tr> <tr><td>8</td><td>L100</td><td>56.2°C</td><td>84.9°C</td></tr> <tr><td>9</td><td>T1</td><td>62.7°C</td><td>90.7°C</td></tr> <tr><td>10</td><td>D102</td><td>68.6°C</td><td>94.9°C</td></tr> <tr><td>11</td><td>D101</td><td>71.3°C</td><td>97.8°C</td></tr> <tr><td>12</td><td>Q2</td><td>68.6°C</td><td>95.5°C</td></tr> <tr><td>13</td><td>Q1</td><td>58.0°C</td><td>84.9°C</td></tr> <tr><td>14</td><td>TSW1</td><td>46.2°C</td><td>72.9°C</td></tr> <tr><td>15</td><td>U200</td><td>55.4°C</td><td>82.2°C</td></tr> <tr><td>16</td><td>C68</td><td>40.4°C</td><td>66.9°C</td></tr> <tr><td>17</td><td>L4</td><td>39.2°C</td><td>65.0°C</td></tr> <tr><td>18</td><td>D22</td><td>60.2°C</td><td>87.6°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 19.5 °C	HIGH AMBIENT Ta= 46.3 °C	1	LF1	32.5°C	58.7°C	2	LF2	41.1°C	67.7°C	3	BD1	51.3°C	77.2°C	4	LF3	47.4°C	74.3°C	5	C5	39.1°C	64.5°C	6	U1	45.2°C	71.7°C	7	C105	48.4°C	75.6°C	8	L100	56.2°C	84.9°C	9	T1	62.7°C	90.7°C	10	D102	68.6°C	94.9°C	11	D101	71.3°C	97.8°C	12	Q2	68.6°C	95.5°C	13	Q1	58.0°C	84.9°C	14	TSW1	46.2°C	72.9°C	15	U200	55.4°C	82.2°C	16	C68	40.4°C	66.9°C	17	L4	39.2°C	65.0°C	18	D22	60.2°C	87.6°C		
NO	Position	ROOM AMBIENT Ta= 19.5 °C	HIGH AMBIENT Ta= 46.3 °C																																																																													
1	LF1	32.5°C	58.7°C																																																																													
2	LF2	41.1°C	67.7°C																																																																													
3	BD1	51.3°C	77.2°C																																																																													
4	LF3	47.4°C	74.3°C																																																																													
5	C5	39.1°C	64.5°C																																																																													
6	U1	45.2°C	71.7°C																																																																													
7	C105	48.4°C	75.6°C																																																																													
8	L100	56.2°C	84.9°C																																																																													
9	T1	62.7°C	90.7°C																																																																													
10	D102	68.6°C	94.9°C																																																																													
11	D101	71.3°C	97.8°C																																																																													
12	Q2	68.6°C	95.5°C																																																																													
13	Q1	58.0°C	84.9°C																																																																													
14	TSW1	46.2°C	72.9°C																																																																													
15	U200	55.4°C	82.2°C																																																																													
16	C68	40.4°C	66.9°C																																																																													
17	L4	39.2°C	65.0°C																																																																													
18	D22	60.2°C	87.6°C																																																																													
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 230 VAC O/P : 117 % LOAD Ta : 25°C	TEST : OK																																																																												
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 264VAC/100VAC O/P : 100 % LOAD Ta= -25 °C	TEST : OK																																																																												

4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C NO DAMAGE	I/P : 272 VAC O/P : FULL LOAD Ta= 52.7 °C HUMIDITY= 95 %R.H	TEST : OK
5	TEMPERATURE COEFFICIENT	± 0.03 %/°C (0~50°C)	I/P : 230 VAC O/P : FULL LOAD	± 0.00232 %/°C (0~50°C)
6	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -40°C~ +85°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC		OK
7	THERMAL SHOCK TEST	1. Thermal shock Temperature : -20°C~ +70°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 230VAC/Full Load AC ON/OFF TEST turn on 58sec ; turn off 2sec		OK
8	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 12min/sweep cycle (4) Acceleration : 2G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C		TEST : OK
9	CAPACITOR LIFE CYCLE	SUPPOSE C105 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME		(1) 293520HRS (2) 50478HRS (3) 62120HRS (4) 89059HRS
10	MTBF	MIL-HDBK-217F TOTAL FAILURE RATE : 230.2 KHRS		
11	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure (Expected Life): Above 50,000 hours @ TA 50°C		

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	FRANK	GESG	WANGDZ

2007/3/20 A50-S014