



Test Report: HLG-40H-42

40W Constant Voltage + Constant Current LED Driver

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST

ENVIRONMENT TEST

■ DESIGN VERIFY TEST

OUTPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------------|---|---|--|
| 1 | CONSTANT CURRENT REGION | 25.2V~42V | I/P : 230VAC O/P : CV=25.2V~41V Ta : 25°C | TEST : OK |
| 2 | RIPPLE & NOISE | V1 : 200 mVp-p (Max) | I/P : 230VAC O/P : FULL LOAD Ta : 25°C | V1 : 21.4 mVp-p (Max) |
| 3 | OUTPUT VOLTAGE ADJUST RANGE | CH1 : 40 V ~ 46 V | I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C | 37.182 V ~ 48.046 V / 230 VAC 37.187 V ~ 48.048 V / 115 VAC |
| 4 | CURRENT ADJUST RANGE | CH1 : 0.58A ~ 0.96A | I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C | 0.522 A ~ 1.029 A / 230 VAC 0.522 A ~ 1.029 A / 115 VAC |
| 5 | OUTPUT VOLTAGE TOLERANCE | V1 : 1 %~ -1 % (Max) | I/P : 100 VAC / 305VAC O/P : FULL / MIN LOAD Ta : 25°C | V1 : 0.12 %~ -0.12 % |
| 6 | LINE REGULATION | V1 : 0.5 %~ -0.5 % (Max) | I/P : 100VAC ~ 305VAC O/P : FULL LOAD Ta : 25°C | V1 : 0.08 %~ -0.08 % |
| 7 | LOAD REGULATION | V1 : 0.5 %~ -0.5 % (Max) | I/P : 230 VAC O/P : FULL ~MIN LOAD Ta : 25°C | V1 : 0.12 %~ -0.12 % |
| 8 | SET UP TIME | 230VAC : 500 ms (Max) 115VAC : 500 ms(Max) | I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C | 230VAC/ 356 ms 115VAC/ 303 ms |
| 9 | RISE TIME | 230VAC : 80 ms (Max) 115VAC : 80 ms (Max) | I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C | 230VAC/ 27 ms 115VAC/ 27 ms |
| 10 | HOLD UP TIME | 230VAC : 16 ms (TYP) 115VAC : 16 ms (TYP) | I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C | 230VAC/ 80 ms 115VAC/ 38 ms |
| 11 | OVER/UNDERSHOOT TEST | < ±5% | I/P : 230 VAC O/P : FULL LOAD Ta : 25°C | TEST : <5 % |
| 12 | DYNAMIC LOAD | V1 : 4200 mVp-p | I/P : 230 VAC (1).O/P : FULL /Min LOAD 90%DUTY/ 1KHZ (2).O/P : FULL /Min LOAD 50%DUTY/ 120HZ Ta : 25°C | (1)118 mVp-p (2)946 mVp-p |

| | | | | | | | | | | | | | |
|----|----------------------------------|---|------------------|--------|--------|--------|--------|--------|--------|--------|---------|--------|--------|
| 13 | DIMMER TEST (for B-type only) | SPEC: | | | | | | | | | | | |
| | | *Reference resistance value for output current adjustment (Typical) | | | | | | | | | | | |
| | | Resistance value | 10K | 20K | 30K | 40K | 50K | 60K | 70K | 80K | 90K | 100K | |
| | | Output current | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% | |
| | | *1 ~ 10V dimming function for output current adjustment (Typical) | | | | | | | | | | | |
| | | Dimming value | 1V | 2V | 3V | 4V | 5V | 6V | 7V | 8V | 9V | 10V | |
| | | Output current | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% | |
| | | *10V PWM signal for output current adjustment (Typical) | | | | | | | | | | | |
| | | Duty value | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% | |
| | | Output current | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% | |
| | | TEST RESULT: I/P : 230 VAC ; Ta : 25°C | | | | | | | | | | | |
| | | 1 | Resistance value | 10K | 20K | 30K | 40K | 50K | 60K | 70K | 80K | 90K | 100K |
| | | | Output current | 0.101A | 0.197A | 0.295A | 0.392A | 0.491A | 0.589A | 0.684A | 0.772A | 0.884A | 0.963A |
| % | 10.50% | | 20.53% | 30.76% | 40.85% | 51.14% | 61.40% | 71.24% | 80.41% | 92.06% | 100.26% | | |
| 2 | Dimming value | 1V | 2V | 3V | 4V | 5V | 6V | 7V | 8V | 9V | 10V | | |
| | Output current | 0.101A | 0.197A | 0.294A | 0.391A | 0.488A | 0.584A | 0.679A | 0.776A | 0.874A | 0.960A | | |
| | % | 10.48% | 20.53% | 30.64% | 40.75% | 50.84% | 60.81% | 70.70% | 80.81% | 91.05% | 100.01% | | |
| 3 | Duty value | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% | | |
| | Output current | 0.126A | 0.227A | 0.325A | 0.421A | 0.513A | 0.604A | 0.694A | 0.782A | 0.871A | 0.961A | | |
| | % | 13.17% | 23.66% | 33.88% | 43.87% | 53.46% | 62.96% | 72.32% | 81.49% | 90.77% | 100.07% | | |

INPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|---------------------------|--|---|--|
| 1 | INPUT VOLTAGE RANGE | 90VAC~305 VAC | I/P : TESTING O/P : FULL LOAD Ta : 25°C | 71.3 V~305V |
| | | | I/P : LOW-LINE-3V= 87 V HIGH-LINE=305 V O/P : FULL/MIN LOAD ON : 30 Sec . OFF : 30 Sec 10MIN (AC POWER ON/OFF NO DAMAGE) | TEST : OK |
| 2 | INPUT FREQUENCY RANGE | 47HZ ~63 HZ NO DAMAGE | I/P : 90 VAC ~ 305 VAC O/P : FULL -MIN LOAD Ta : 25°C | TEST : OK |
| 3 | POWER FACTOR | 0.95 / 230 VAC(TYP) 0.98 / 115 VAC(TYP) 0.92 / 277 VAC(TYP) | I/P : 230 VAC I/P : 115 VAC I/P : 277VAC O/P : FULL LOAD Ta : 25°C | PF= 0.960 / 230 VAC PF= 0.996 / 115 VAC PF= 0.935 / 277 VAC |
| 4 | EFFICIENCY | 88.5 % (TYP) | I/P : 230 VAC O/P : FULL LOAD Ta : 25°C | 89.07 % |
| 5 | INPUT CURRENT | 277V/ 0.23 A (TYP) 230V/ 0.24 A (TYP) 115V/ 0.43 A (TYP) | I/P : 277 VAC I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C | I = 0.1774 A/ 277 VAC I = 0.202 A/ 230 VAC I = 0.39 A/ 115 VAC |
| 6 | INRUSH CURRENT | 230V/ 50 A (TYP) COLD START | I/P : 230 VAC O/P : FULL LOAD Ta : 25°C | I = 51 A/ 230 VAC |
| 7 | LEAKAGE CURRENT | < 0.75 mA / 277 VAC | I/P : 277 VAC O/P : Min LOAD Ta : 25°C | L-FG : 0.22 mA N-FG : 0.20 mA |
| 8 | TOTAL HARMONIC DISTORTION | THD< 20% when output loading ≥ 60% at 115VAC/230VAC input and output loading ≥ 75% at 277VAC input | I/P : 115 VAC I/P : 230 VAC O/P : 60% LOAD I/P : 277 VAC O/P : 75%LOAD Ta : 25°C | THD : 8.53 /115VAC THD : 16.72 /230VAC THD : 18.31 /277VAC |

PROTECTION FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------------|--|---|--|
| 1 | OVER LOAD PROTECTION | 95 % ~ 108 % | I/P : 230 VAC I/P : 115 VAC O/P : TESTING Ta : 25°C | 105 %/ 230 VAC 105 %/ 115 VAC Constant current limiting, recovers automatically after fault condition is removed |
| 2 | OVER VOLTAGE PROTECTION | CH1 : 48 V ~ 58 V | I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C | 51.57 V/ 230 VAC 51.34 V/ 115 VAC Shut down o/p voltage, re-power on to recover |
| 3 | OVER TEMPERATURE PROTECTION | NO DAMAGE | I/P : 230 VAC O/P : FULL LOAD | O.T.P. Active Shut down o/p voltage, re-power on to recover |
| 4 | SHORT PROTECTION | SHORT EVERY OUTPUT 1 HOUR NO DAMAGE | I/P : 305 VAC O/P : FULL LOAD Ta : 25°C | NO DAMAGE Hiccup mode, recovers automatically after fault condition is removed |

COMPONENT STRESS TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|--|--------------------------|--|--|
| 1 | Power Transistor (D to S) or (C to E) Peak Voltage | Q 1 Rated : 10A/600V | I/P : High-Line +3V = 308 V O/P : (1)Full Load Turn on (2) Output Short (3)Full load continue Ta : 25°C | (1) 564 V (2) 464 V (3) 466 V |
| 2 | Diode Peak Voltage | D101 Rated : 20A/200V | I/P : High-Line +3V = 308 V O/P : (1)Full Load Turn on (2)Output Short (3)Full load continue Ta : 25°C | (1) 199 V (2) 198 V (3) 182 V |
| 3 | Clamp Diode Peak Voltage | D2 Rated : 2A/800V | I/P : High-Line +3V = 308 V O/P : (1) Dynamic Load 90%Duty/1KHz (2)Full load continue Ta : 25°C | (1) 604 V (2) 604 V |
| 4 | Input Capacitor Voltage | C 5 Rated : 33u/450V | I/P : High-Line +3V = 308 V O/P : (1)Full Load Turn on /Off (2) Min load Turn on /Off (3)Full Load /Min load Change Ta : 25°C | (1) 428.65 V (2) 433.57 V (3) 434.89 V |
| 5 | Control IC Voltage Test | U1 Rated : 11V~30V | I/P : High-Line +3V = 308 V O/P : (1)Full Load Turn on /Off (2) Min load Turn on /Off (3)Full Load /Min load Change Ta : 25°C | (1) 21.419 V (2) 21.479 V (3) 21.492 V |
| 6 | Power Transistor (D to S) or (C to E) Peak Voltage | Q3 Rated : 7.5A/700V | I/P : High-Line +3V = 308 V O/P : (1)Full Load Turn on (2) Output Short (3)Full load continue Ta : 25°C | (1) 660 V (2) 608 V (3) 644 V |

■ SAFETY & E.M.C. TEST

SAFETY TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|----------------------|---|---|---|
| 1 | WITHSTAND VOLTAGE | I/P-O/P : 3.75 KVAC/min I/P-FG : 2KVAC/min4.5mA O/P-FG : 1.5 KVAC/min | I/P-O/P : 4 KVAC/min I/P-FG : 2.4KVAC/min O/P-FG : 1.8KVAC/min Ta : 25°C | I/P-O/P : 1.857 mA I/P-FG : 2.260 mA O/P-FG : 0.494 mA NO DAMAGE |
| 2 | ISOLATION RESISTANCE | I/P-O/P : 500VDC>100MΩ I/P-FG : 500VDC>100MΩ O/P-FG : 500VDC>100MΩ | I/P-O/P : 500 VDC I/P-FG : 500 VDC O/P-FG : 500 VDC Ta : 25°C /70%RH | I/P-O/P : 30 GΩ I/P-FG : 30 GΩ O/P-FG : 30 GΩ NO DAMAGE |
| 3 | GROUNDING CONTINUITY | FG(PE) TO CHASSIS OR TRACE < 100 mΩ | 40 A / 2min Ta : 25°C / 70%RH | 18 mΩ |

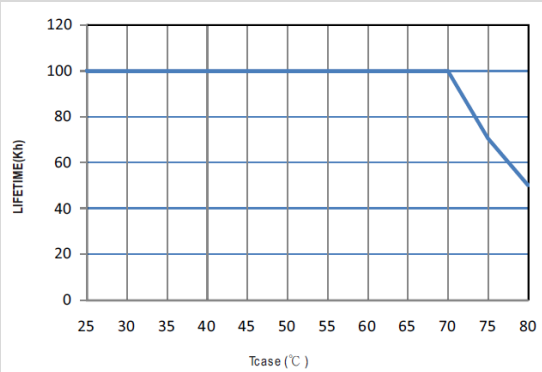
E.M.C TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|------------|--|---|-------------------------------|
| 1 | HARMONIC | EN61000-3-2 CLASS C | I/P: 230VA50HZ O/P:100% ELECTRONIC LOAD O/P:100%/LED LOAD Ta:25°C | PASS |
| 2 | CONDUCTION | EN55015 CLASS B | I/P: 230 VAC (50HZ) O/P:FULL LOAD Ta:25°C | PASS Test by certified Lab |
| 3 | RADIATION | EN55015 CLASS B | I/P: 230 VAC (50HZ) O/P:FULL LOAD Ta:25°C | PASS Test by certified Lab |
| 4 | E.S.D | EN61000-4-2 INDUSTRY AIR:8KV / Contact:4KV | I/P: 230 VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |
| 5 | E.F.T | EN61000-4-4 INDUSTRY INPUT: 2KV | I/P: 230 VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |
| 6 | SURGE | IEC61000-4-5 INDUSTRY L-N :2KV L,N-PE:4KV | I/P: 230 VAC/50HZ O/P:FULL LOAD Ta:25°C | CRITERIA A |

■ RELIABILITY TEST

ENVIRONMENT TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----|---|--|--|--------------------|----------|-----------------------------|-----------------------------|---|-----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|------|--------|--------|---|----|--------|--------|---|----|--------|--------|---|-----|--------|--------|---|----|--------|--------|----|------|--------|--------|----|------|--------|--------|----|-------|--------|--------|--|
| 1 | TEMPERATURE RISE TEST | MODEL : HLG-40H-24 1. ROOM AMBIENT BURN-IN : 2.5 HRS I/P : 230VAC O/P : 95% LOAD Ta= 28.4 °C 2. HIGH AMBIENT BURN-IN : 23.5 HRS I/P : 230VAC O/P : 95% LOAD Ta= 68 °C | <table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 25.1 °C</th> <th>HIGH AMBIENT Ta= 63.8 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF2</td><td>43.3°C</td><td>79.7°C</td></tr> <tr><td>2</td><td>Q1</td><td>45.2°C</td><td>81.5°C</td></tr> <tr><td>3</td><td>Q3</td><td>50.2°C</td><td>86.8°C</td></tr> <tr><td>4</td><td>U1</td><td>47.6°C</td><td>84.2°C</td></tr> <tr><td>5</td><td>RTH2</td><td>43.2°C</td><td>79.4°C</td></tr> <tr><td>6</td><td>D2</td><td>49.8°C</td><td>86.7°C</td></tr> <tr><td>7</td><td>C5</td><td>43.8°C</td><td>80.1°C</td></tr> <tr><td>8</td><td>C16</td><td>43.7°C</td><td>79.7°C</td></tr> <tr><td>9</td><td>T1</td><td>49.7°C</td><td>85.5°C</td></tr> <tr><td>10</td><td>D101</td><td>50.3°C</td><td>86.4°C</td></tr> <tr><td>11</td><td>C106</td><td>45.4°C</td><td>81.4°C</td></tr> <tr><td>12</td><td>LF100</td><td>44.7°C</td><td>80.8°C</td></tr> </tbody> </table> | NO | Position | ROOM AMBIENT Ta= 25.1 °C | HIGH AMBIENT Ta= 63.8 °C | 1 | LF2 | 43.3°C | 79.7°C | 2 | Q1 | 45.2°C | 81.5°C | 3 | Q3 | 50.2°C | 86.8°C | 4 | U1 | 47.6°C | 84.2°C | 5 | RTH2 | 43.2°C | 79.4°C | 6 | D2 | 49.8°C | 86.7°C | 7 | C5 | 43.8°C | 80.1°C | 8 | C16 | 43.7°C | 79.7°C | 9 | T1 | 49.7°C | 85.5°C | 10 | D101 | 50.3°C | 86.4°C | 11 | C106 | 45.4°C | 81.4°C | 12 | LF100 | 44.7°C | 80.8°C | |
| NO | Position | ROOM AMBIENT Ta= 25.1 °C | HIGH AMBIENT Ta= 63.8 °C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | LF2 | 43.3°C | 79.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | Q1 | 45.2°C | 81.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | Q3 | 50.2°C | 86.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | U1 | 47.6°C | 84.2°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | RTH2 | 43.2°C | 79.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | D2 | 49.8°C | 86.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | C5 | 43.8°C | 80.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | C16 | 43.7°C | 79.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | T1 | 49.7°C | 85.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | D101 | 50.3°C | 86.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 | C106 | 45.4°C | 81.4°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 | LF100 | 44.7°C | 80.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | LOW TEMPERATURE TURN ON TEST | TURN ON AFTER 2 HOUR | I/P : 305VAC/100VAC O/P : 95% LOAD Ta= -40°C / -25°C | TEST : OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST | AFTER 12 HOURS IN CHAMBER ON CONTROL 60 °C NO DAMAGE | I/P : 305 VAC O/P : 95% LOAD Ta= 60 °C HUMIDITY= 95 %R.H | TEST : OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | TEMPERATURE COEFFICIENT | ± 0.03 % (0~50°C) | I/P : 230 VAC O/P : 95% LOAD | ± 0.001 % (0~50°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | STORAGE TEMPERATURE TEST | 1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC | | OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | THERMAL SHOCK TEST | 1. Thermal shock Temperature : -40°C~ +65°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 230VAC/Fu11 Load AC ON/OFF TEST turn on 58sec ; turn off 2sec | | OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| | | | |
|----|-----------------------------|---|---|
| 7 | VIBRATION TEST | 1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10-500Hz (3) Sweep Time : 12min/sweep cycle (4) Acceleration : 5G (5) Test Time : 72min in each axis (X.Y.Z) (6) Ta : 25°C | TEST : OK |
| 8 | CAPACITOR LIFE CYCLE | HLG-40H-24 :SUPPOSE C106 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta=25 °C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta=60 °C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 60 °C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 60 °C LIFE TIME | (1) 770489 HRS (2) 87424 HRS (3) 100349HRS (4) 119922HRS |
| 9 | MTBF | Conducted by Parts Stress Analysis Prediction 1131.9K hrs min. Telcordia SR-332 (Bellcore) ; 336.5K hrs min. MIL-HDBK-217F (25°C) | |
| 10 | DMTBF/Accelerated Life Test | Demonstration Mean Time Between Failure(Expected Life) : 62,000 hours @ Tcase 75°C  | |

| TEST RESULT | TESTER | REVIEW | APPROVAL |
|-------------|------------|------------|---------------|
| PASS | DANIEL GAO | SANFORD SU | VINCENT TSENG |

2009/08/04 A50-F023