



# Test Report : SHP-10K-230

---

10KW 3 $\psi$  3W High Efficiency Digital Power Supply

## ■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Control Function Test

Component Stress Test

## ■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test


## ■ RELIABILITY TEST

ENVIRONMENT TEST

■ DESIGN VERIFY TEST

OUTPUT FUNCTION TEST


NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1 : 170V~ 260 V	I/P : 400VAC I/P : 340 VAC O/P : MIN LOAD Ta : 25°C	164.2V~267.43V 164.2V~267.43V
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1 : 1%~ -1 %	I/P : 340VAC /530VAC O/P : FULL/ MIN. LOAD Ta : 25°C	V1: 0%~ -0.2 %
3	LINE REGULATION (Max)	V1 : 0.5%~ -0.5 %	I/P : 340VAC~ 530VAC O/P : FULL LOAD Ta : 25°C	V1: 0.07%~ -0.09 %
104	LOAD REGULATION(Max)	V1 : 0.5%~ -0.5 %	I/P : 400VAC O/P : FULL ~MIN LOAD Ta : 25°C	V1: 0.39 %~ -0.06%
5	OVER/UNDERSHOOT TEST	< $\pm$ 10%	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	< $\pm$ 10%
6	RIPPLE & NOISE(Max)	V1 : 1Vp-p	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	V1: 490mVp-p
<div style="display: flex; justify-content: space-around;"> <div style="width: 45%;"> <p>high frequency :</p> </div> <div style="width: 45%;"> <p>low frequency :</p> </div> </div>				
7	SET UP TIME(Max)	400VAC / 3000ms	I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	1940 ms
INPUT=400VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage				

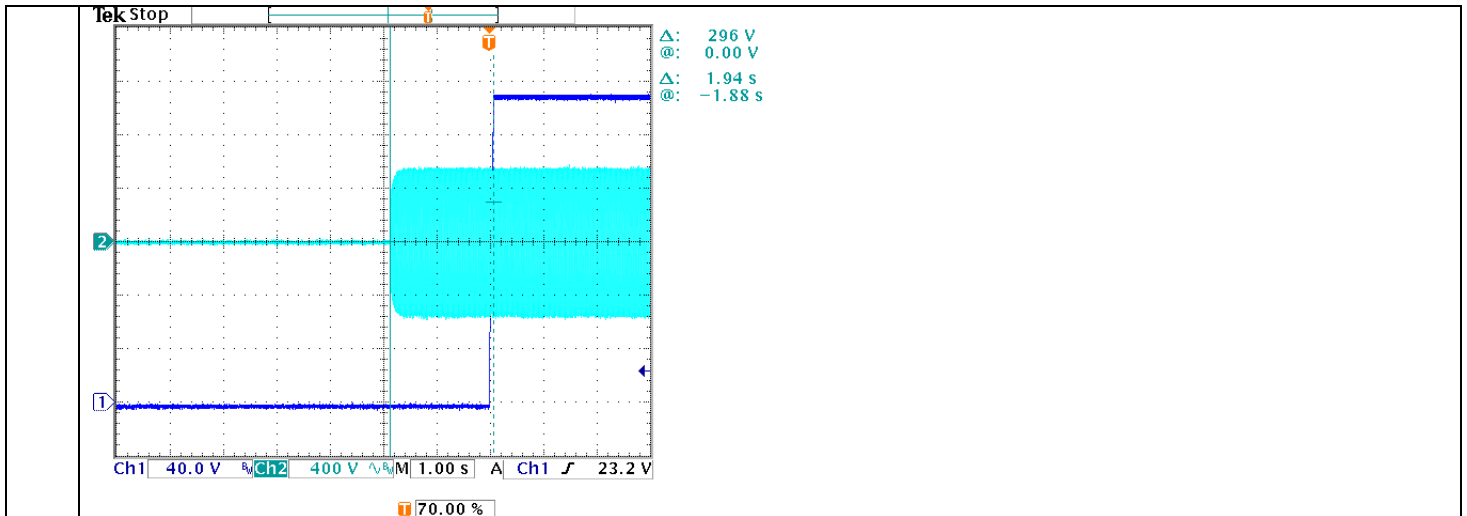

8	RISE TIME (Max)	400VAC/100ms	I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	71 ms
---	-----------------	--------------	---	-------

INPUT=400VAC/50HZ @ FULL LOAD


CH3 : Output Voltage

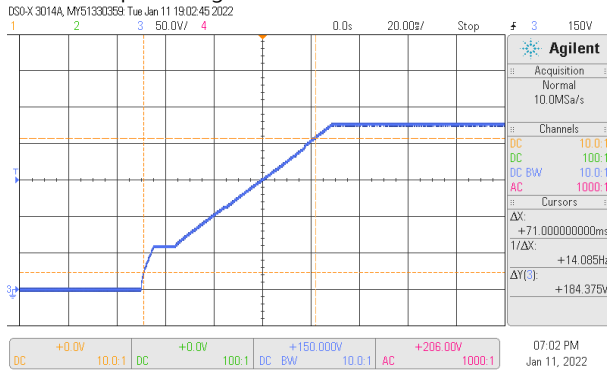

9	HOLD UP TIME (Typ.)	20ms / 400VAC at full load 25ms / 400VAC at 75% load	I/P : 400VAC O/P : FULL LOAD O/P : 75% load Ta : 25°C	21.0ms @ full load 28.6ms @ 75% load
---	---------------------	---	--	---


INPUT=400VAC/50HZ @ FULL LOAD

CH3 : Output Voltage CH4 : AC Input Voltage

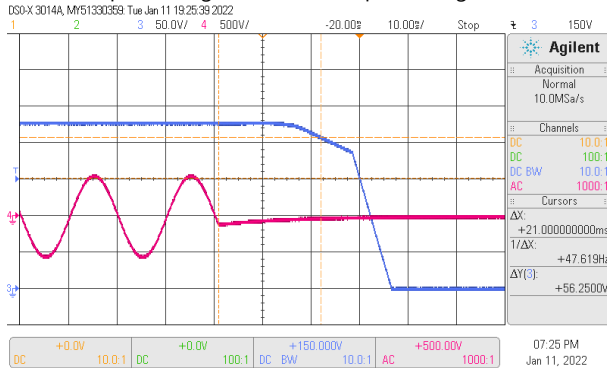


INPUT=400VAC/50HZ @ 75% LOAD

CH1 : Output Voltage CH2 : AC Input Voltage

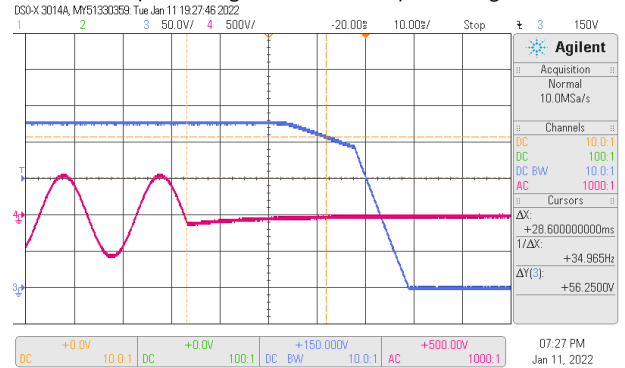


10	DYNAMIC LOAD	V1 : 23Vp-p	I/P : 400VAC O/P : (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY /	1.97Vp-p 1.65Vp-p
----	--------------	-------------	---	----------------------

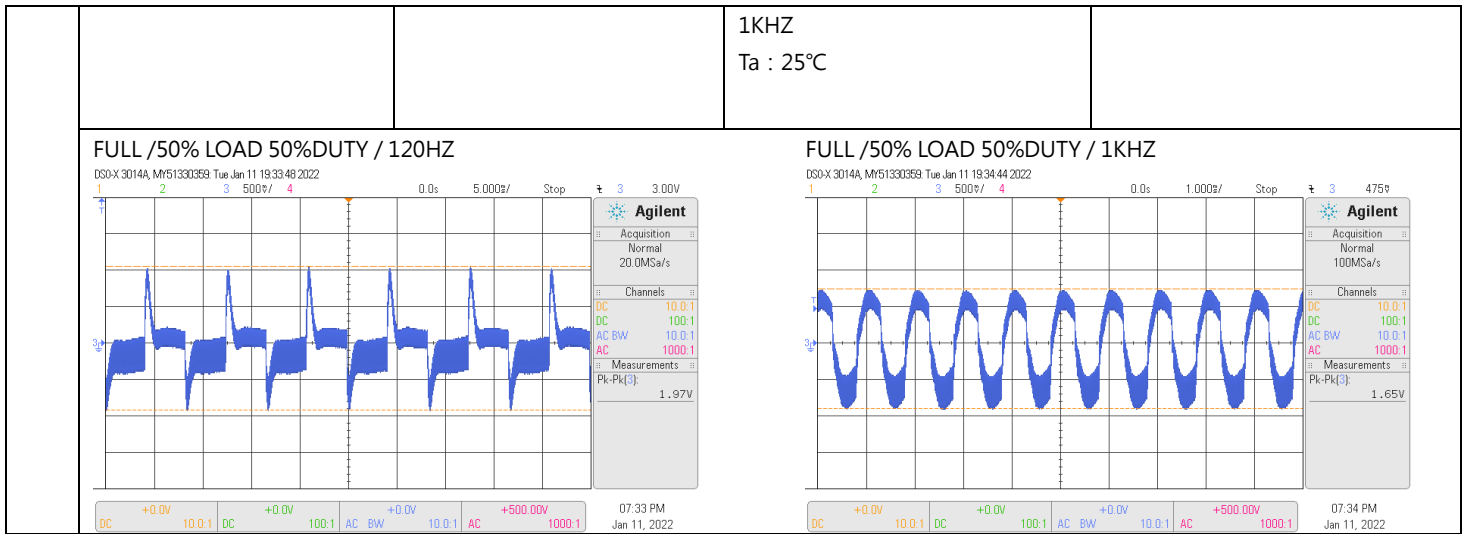


### INPUT FUNCTION TEST


NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	340VAC~530VAC	(1) I/P : TESTING O/P : FULL LOAD Ta : 25°C I/P : LOW-LINE-3V=337V HIGH-LINE+10V=540 V O/P : FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON : 30 Sec OFF : 30 Sec 10MIN ( POWER ON/OFF NO DAMAGE )	(1) 335.2V~530V  TEST: PASS
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P : 340 VAC ~530 VAC O/P : FULL~MIN LOAD Ta : 25°C	TEST: PASS
3	INPUT CURRENT (Typ.)	400V / 15.7 A 480V/ 13 A	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	I =15.11 A / 400VAC I =12.54 A / 480VAC
4	LEAKAGE CURRENT	< 6.5mA / 530 VAC	I/P : 530 VAC O/P : Min LOAD Ta : 25°C	L1-FG : 5.2mA peak L2-FG : 5.2mA peak L3-FG : 5.2mA peak
5	POWER FACTOR (Typ.)	$\geq 0.98$ / 400VAC $\geq 0.98$ / 480VAC	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	PF=1.00 / 400VAC PF=1.00 / 480VAC
	P.F vs LOAD			

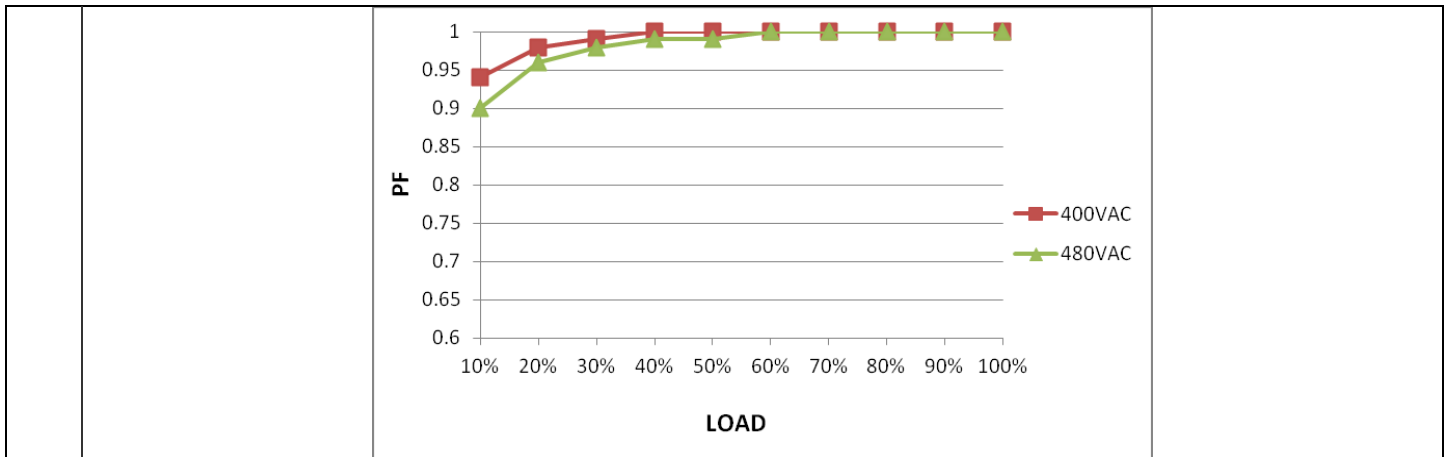

7	EFFICIENCY(Typ.)	96.5%	I/P : 480VAC O/P : FULL LOAD Ta : 25°C	96.6 %
---	------------------	-------	--	--------

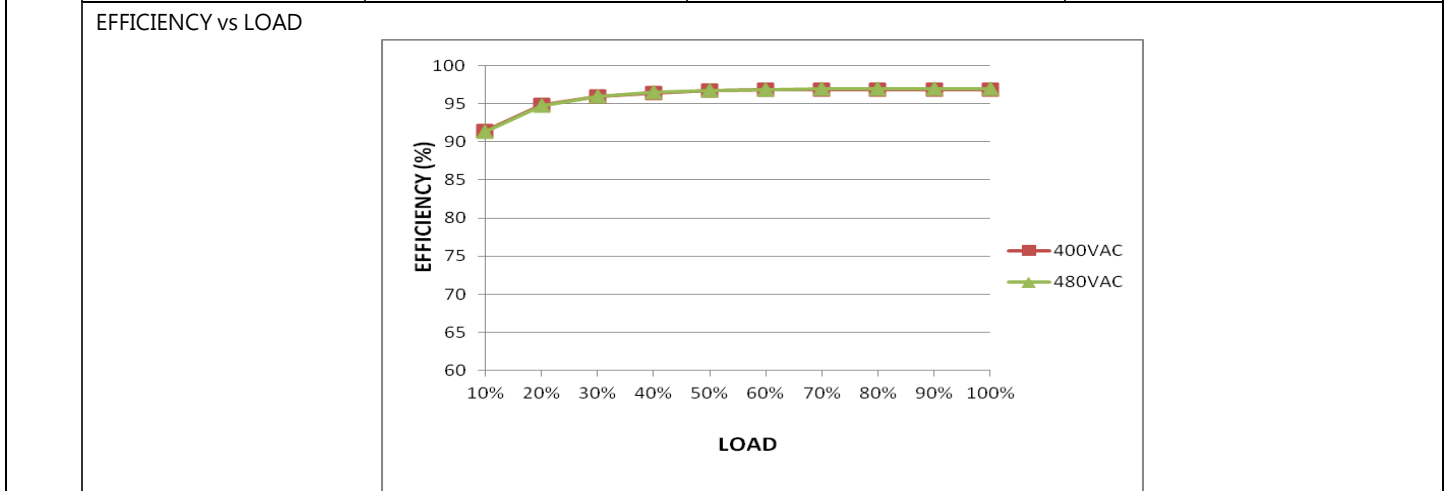

7	INRUSH CURRENT(Typ.)	40A@400VAC 65A@480VAC COLD START	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	I = 33.2A/ 400VAC T50=2380ms I = 43.6A/ 480VAC T50=2580ms
---	----------------------	--	---	--

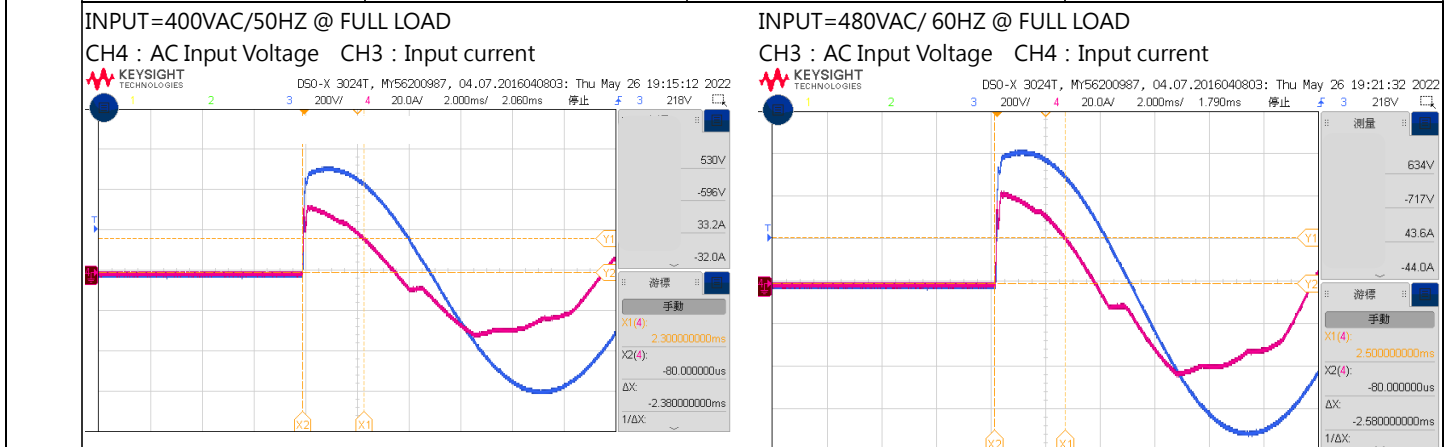

### PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	100%~ 105 %  PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover	I/P : 530 VAC I/P : 400VAC I/P : 340VAC O/P : TESTING Ta : 25°C	103.87 %/ 530 VAC 103.85 %/ 400VAC 103.91%/ 340VAC PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover
2	OVER VOLTAGE PROTECTION	273V~312V PROTECTION TYPE : Shut down o/p voltage, re-power on to recover	I/P : 530 VAC I/P : 400VAC I/P : 340 VAC O/P : MIN LOAD Ta : 25°C	285.74V/ 530VAC 285.94V/ 400VAC 285.9V / 340VAC PROTECTION TYPE : Shut down o/p voltage, re-power on to recover
3	OVER TEMPERATURE PROTECTION	Protection type : Shut down o/p voltage, recovers automatically after temperature goes down	I/P : 530 VAC I/P : 340 VAC O/P : FULL LOAD	O.T.P. Active Protection type : Shut down o/p voltage, recovers automatically after temperature goes down
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P : 530 VAC I/P : 340 VAC O/P : FULL LOAD Ta : 25°C	NO DAMAGE PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover

### CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT								
1	AUXILIARY POWER (AUX)	Auxiliary voltage output, 11.4~12.6V, referenced to GND-AUX (pin15 & 16). The maximum load current is 1A. This output is not controlled by "Remote ON-OFF" . I/P : 400VAC O/P : FULL LOAD Ta : 25°C  Test Result : PASS										
		<table border="1"> <thead> <tr> <th>AUX</th> <th>TOLERANCE</th> <th>RIPPLE</th> <th>TEST RESULT</th> </tr> </thead> <tbody> <tr> <td>12V / 1A</td> <td>11.4~12.6V</td> <td>150mVp-p</td> <td>No Load : 12.049V Full Load : 11.734V Ripple : 80mV</td> </tr> </tbody> </table>			AUX	TOLERANCE	RIPPLE	TEST RESULT	12V / 1A	11.4~12.6V	150mVp-p	No Load : 12.049V Full Load : 11.734V Ripple : 80mV
AUX	TOLERANCE	RIPPLE	TEST RESULT									
12V / 1A	11.4~12.6V	150mVp-p	No Load : 12.049V Full Load : 11.734V Ripple : 80mV									


2 REMOTE ON/OFF CONTROL

**4.Remote ON-OFF Control**

※ The power supply can be turned ON-OFF by using the "Remote ON-OFF" function.

Between Remote ON-OFF(CN86 pin1) and 5V-AUX(CN86 pin2)	Output Status
Switch close (Short)	power supply ON
Switch open (Open)	power supply OFF

Table 4.1

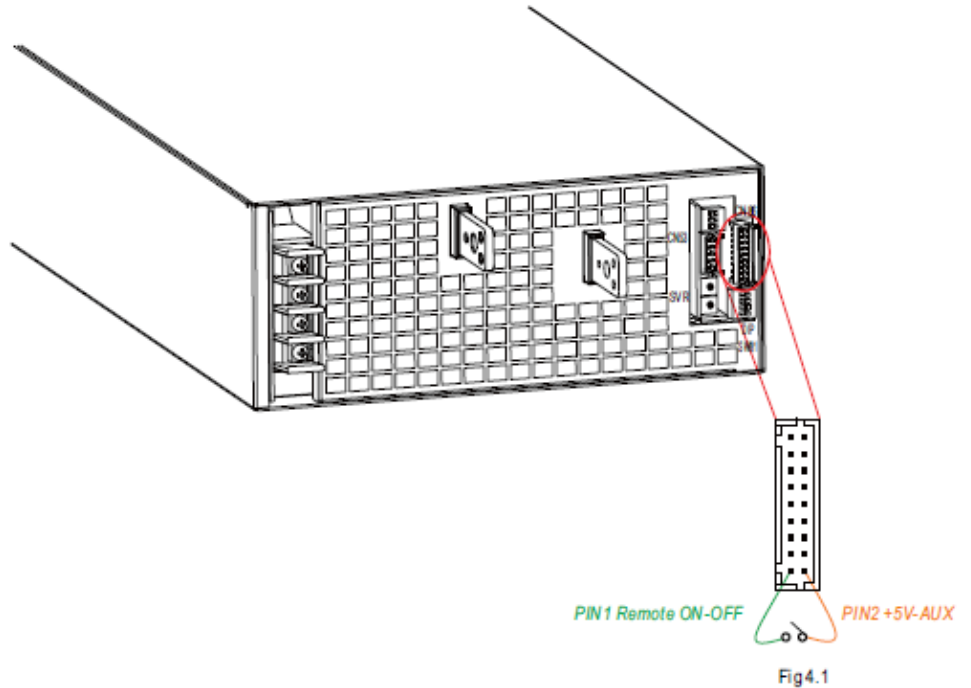

I/P : 400VAC  
 O/P : FULL LOAD  
 Ta : 25°C  
 Test Result : PASS

Between Remote ON-OFF(CN86 pin1) and 5V-AUX(CN86 pin2)	Output Status
Switch close (Short)	power supply ON
Switch open (Open)	power supply OFF

3 ALARM SIGNAL

5. Alarm Signal Output

※ There are 4 alarm signals, DC-OK, T-ALARM, Fan Fail and AC-OK, in TTL signal form, on CN86. These signals are isolated from output.

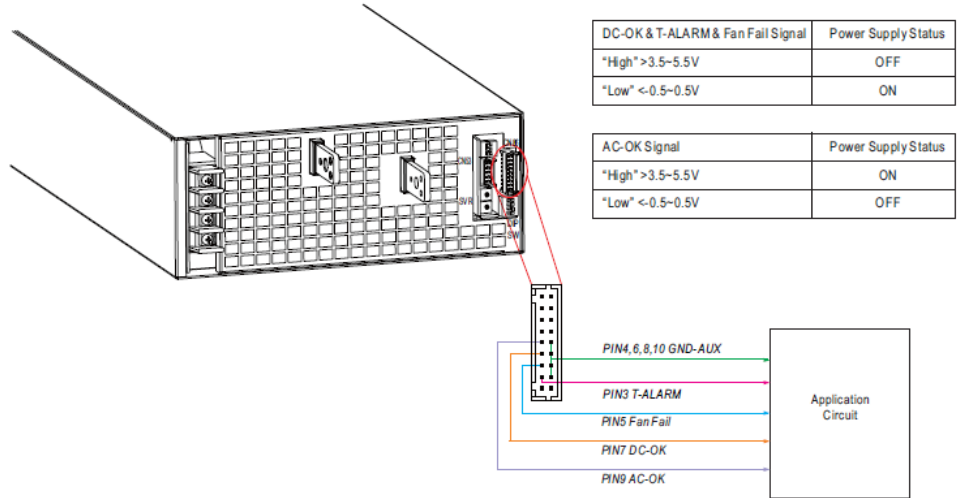


Fig 5.1

※ DC OK might mis-triggered when the voltage difference between PSU and the load, please minimized the unnecessary voltage difference.

1. DC OK SIGNAL

High (3.5 ~ 5.5V) : When the  $V_{out} \leq 80\% \pm 6\%$ .  
 Low (-0.5 ~ 0.5V) : When the  $V_{out} \geq 80\% \pm 6\%$ .  
 The maximum sourcing current is 10mA and only for output.

I/P : 400VAC  
 O/P : FULL LOAD  
 Ta : 25°C

Test Result :

Vout	DC OK SIGNAL
$V_{out} \leq 74\%$	5.05V
$V_{out} \geq 86\%$	0V

2. T-ALARM

High (3.5 ~ 5.5V) : When the internal temperature exceeds the limit of temperature alarm.  
 Low (-0.5 ~ 0.5V) : When the internal temperature is normal.  
 The maximum sourcing current is 10mA and only for output.(Note)

I/P : 400VAC  
 O/P : FULL LOAD  
 Ta : 25°C

Test Result :

PSU STATUS	T-ALARM SPEC	T-ALARM TEST
NORMAL	-0.5 ~ 0.5V	0V
OTP	3.5~5.5V	5.02V



3. AC OK  
 High (3.5 ~ 5.5V): When AC input  $\geq 335 \pm 1.5\%$  Vac, PSU works normally.  
 Low (-0.5 ~ 0.5V): When AC input  $\leq 320 \pm 1.5\%$  Vac, PSU shut down.  
 The maximum sourcing current is 10mA and only for output.(Note)  
 I/P : 400VAC  
 O/P : FULL LOAD  
 Ta : 25°C  
 Test Result :


AC	AC OK SIGNAL
$AC \leq 320V$	0V
$AC \geq 335V$	5.06V


4. FAN FAIL  
 High(3.5~5.5V):When the fan fail.  
 Low(-0.5~0.5V):When the fan works normally.  
 The maximum sourcing current is 10mA and only for output.(Note)  
 I/P : 400VAC  
 O/P : FULL LOAD  
 Ta : 25°C  
 Test Result :



FAN	AC OK SIGNAL
Fan works	0V
Fan lock	5.05V

4 OUTPUT VOLTAGE PROGRAMMABLE(PV)


1. Output Voltage Programming (or, PV / remote voltage programming / remote adjust / margin programming / dynamic voltage trim)

(1) by potentiometer (SVR)  
 (a) Have the DIP switch position-3 set as   
 (b) Output voltage can be trimmed by SVR.

(2) by Output Voltage Programming  
 (a) Have the DIP switch position-3 set as   
 (b) The output voltage can be trimmed to 50~120% by applying EXTERNAL VOLTAGE between PV+ and PV- on CN53.

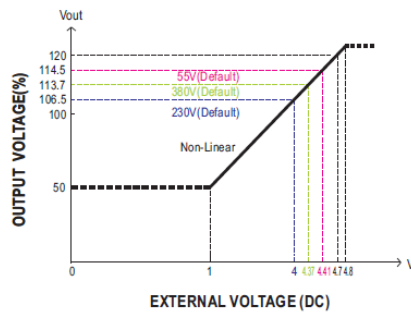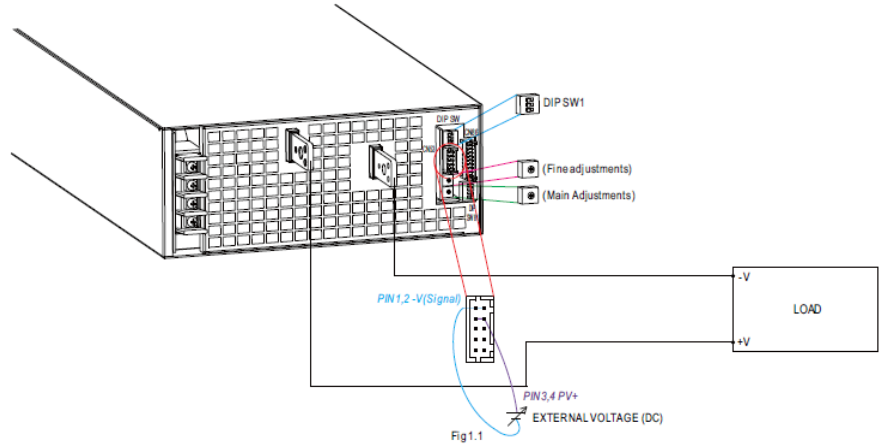

© The 100% output voltage is 48/115/216/334V.

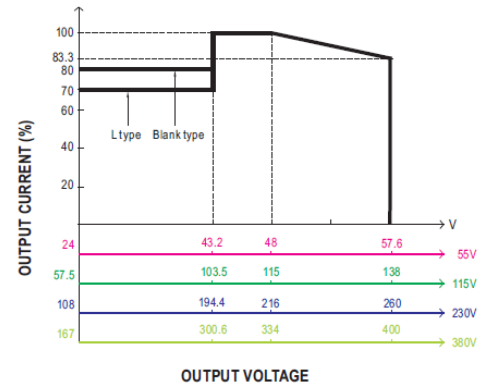

© The rated current should change with the Output Voltage Programming accordingly.


I/P: 400VAC  
 O/P: FULL LOAD  
 Ta: 25°C  
 TEST RESULT :

MODEL \ PV	1V	5V
	SPEC	108V $\pm$ 5%
Vout	107.07V	264.2V



5 OUTPUT CURRENT PROGRAMMABLE (PC)

2. Constant Current Programming (or, PC / remote current programming / dynamic current trim)

- (1) Default Overload Protection(OLP) value
  - (a) Have the DIP switch position-2 set as
  - (b) Output current is set default value.
- (2) by Constant Current Level Programming
  - (a) Have the DIP switch position-2 set as
  - (b) The constant current level can be trimmed to 20~100% of the rated current by applying EXTERNAL VOLTAGE between PC+ and PC- on CN53.

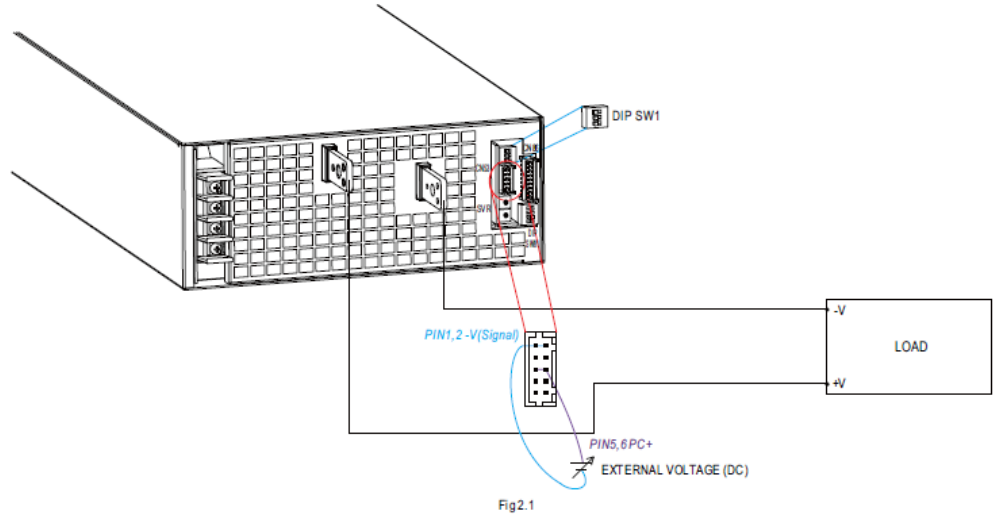

※ Under PC function at wattage < 4KW, the power supply might enter burst mode and cause output unstable, please increase the load to minimized the effect.  
 ※ Auto de-rating function covered by over temperature protection, it works either in PC mode or under control by communication protocol.  
 T<sub>1</sub>(Typ.): Maximum ambient temperature of full load.  
 T<sub>2</sub>(Typ.): T<sub>1</sub>+5°C.

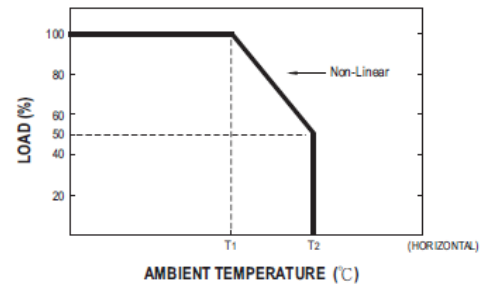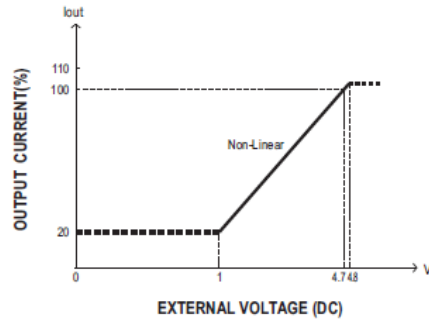

I/P : 400VAC  
 O/P : TESTING (factory default)  
 Ta : 25°C

	PC	1V	5V
MODEL			
SPEC		9.26A±10%	44.44A±10%
lout		9.08A	44.88A

6	CURRENT SHARING	CURRENT SHARING TOLERANCE $\leq \pm 10\%$	I/P : 400 VAC O/P : 230V (factory default) 100/50% LOAD Ta : 25°C	O/P : 100% PSU1 : 42.1 A PSU2 : 43.2 A PSU3 : 43.4 A PSU4 : 43 A O/P : 50% PSU1 : 21 A PSU2 : 21.7 A PSU3 : 21.9 A PSU4 : 21.5 A
---	-----------------	--	--	---

### COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT	
1	PWM Transistor ( D to S) or (C to E) Peak Voltage	Q400 Rated : 91A/1200V VGS : -10V~+22V  Q401 Rated : 95A/1200V VGS : -10V~+22V	AC ON/OFF I/P : High-Line +3V =533V VDS : <u>VO : 230V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. Ta : 25°C	Q401 <b>Vac533V</b> <u>VO : 230V</u> VDS : (1) 913V (2) 921V (3) 913V (4) 913V (5) 913V (6) 921V (7) 913V	Q400 <b>Vac533V</b> <u>VO : 230V</u> VDS : (1) 979V (2) 979V (3) 963V (4) 963V (5) 963V (6) 979V (7) 995V
2	P.F.C Transistor ( D to S) or (C to E) Peak Voltage	Q163 Rated : 119A/650V VGS : -10~+22V	I/P : High-Line +3V =533V AC ON/OFF <u>VO : 230V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. Ta : 25°C	<u>VO : 230V</u> VDS/IDS : (1) 513V / 21.7A (2) 517V /28.8A (3) 505V /19.76A (4) 509V /19.76 (5) 509V/18.97A (6) 477V / 12.6A (7) 521V / 28.458A	

3	P.F.C DIODE	D163 Rated : 15A/1200V	I/P : High-Line +3V =533V AC ON/OFF VO : 230V O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz Ta : 25°C	VO : 230V  (1) 932V (2) 892V (3) 908V (4) 884V	
4	Diode Peak Voltage	D611 Rated : 8 A/ 650 V  D613 Rated : 8 A/ 650 V  D616 Rated : 8 A/ 650 V  D619 Rated : 8 A/ 650 V	AC ON/OFF I/P : High-Line +3V =533 V VO : 230V O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. (8).NO LOAD Ta : 25°C	D611 : VO : 230V VDS : (1) 549V (2) 537V (3) 528V (4) 541V (5) 552V (6) 556V (7) 564V (8) 525V  D613 : VO : 230V VDS : (1) 552V (2) 545V (3) 556V (4) 556V (5) 556V (6) 560V (7) 564V (8) 529V	D616 : VO : 230V VDS : (1) 556V (2) 560V (3) 552V (4) 560V (5) 556V (6) 560V (7) 564V (8) 529V  D619 : VO : 230V VDS : (1) 556V (2) 564V (3) 556V (4) 560V (5) 560V (6) 564V (7) 564V (8) 525V

■ SAFETY& E.M.C. TEST

**SAFETY TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P : 3.75KVAC/min I/P-FG : 2KVAC/min O/P-FG : 1.25KVAC/min	I/P-O/P : 4.125KVAC/min I/P-FG : 2.4 KVAC/min O/P-FG : 1.5 KVAC/min Ta : 25°C	I/P-O/P : 19.06mA I/P-FG : 14.93mA O/P-FG : 16.34m A NO DAMAGE

2	ISOLATION RESISTANCE	I/P-O/P : 500VDC>100M $\Omega$ I/P-FG : 500VDC>100M $\Omega$ O/P-FG : 500VDC>100M $\Omega$	I/P-O/P : 500 VDC I/P-FG : 500 VDC O/P-FG : 500 VDC Ta : 25°C	I/P-O/P : 16 G $\Omega$ I/P-FG : 27.8G $\Omega$ O/P-FG : >30 G $\Omega$ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 m $\Omega$	40A / 2min Ta : 25°C	25m $\Omega$

### E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
2	CONDUCTION	EN55032 /EN55011 CLASS B	I/P : 400VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS
3	RADIATION	EN55032 /EN55011 CLASS A	I/P : 400VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS
4	E.S.D	EN61000-4-2 <u>INDUSTRY</u> AIR : 8KV / Contact : 4KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
5	E.F.T	EN61000-4-4 <u>INDUSTRY</u> INPUT : 2KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
6	SURGE	IEC61000-4-5 <u>INDUSTRY</u> L-N : 2KV L,N-PE : 4KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
7	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			

■ **RELIABILITY TEST**

**ENVIRONMENT TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																																																
1	TEMPERATURE RISE TEST	MODEL : SHP-10K-115 1. ROOM AMBIENT BURN-IN : 1.5 HRS I/P : 400VAC O/P : FULL LOAD Ta= 25 °C 2. HIGH AMBIENT BURN-IN : 2HRS I/P : 400VAC O/P : FULL LOAD Ta= 50 °C																																																																																																																																		
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 25°C</th> <th>HIGH AMBIENT Ta= 50°C</th> </tr> </thead> <tbody> <tr><td>1</td><td>C110</td><td>33.0°C</td><td>55.4°C</td></tr> <tr><td>2</td><td>D162</td><td>79.7°C</td><td>97.0°C</td></tr> <tr><td>3</td><td>D163</td><td>75.6°C</td><td>91.4°C</td></tr> <tr><td>4</td><td>L5</td><td>39.0°C</td><td>64.7°C</td></tr> <tr><td>5</td><td>Q160</td><td>74.5°C</td><td>88.6°C</td></tr> <tr><td>6</td><td>Q161</td><td>71.8°C</td><td>82.2°C</td></tr> <tr><td>7</td><td>Q162</td><td>90.7°C</td><td>104.5°C</td></tr> <tr><td>8</td><td>Q163</td><td>81.7°C</td><td>102.1°C</td></tr> <tr><td>9</td><td>Q164</td><td>85.7°C</td><td>103.7°C</td></tr> <tr><td>10</td><td>Q165</td><td>83.7°C</td><td>95.3°C</td></tr> <tr><td>11</td><td>RG2</td><td>32.2°C</td><td>59.8°C</td></tr> <tr><td>12</td><td>U301</td><td>37.4°C</td><td>61.8°C</td></tr> <tr><td>13</td><td>T221</td><td>32.0°C</td><td>58.1°C</td></tr> <tr><td>14</td><td>C173</td><td>29.7°C</td><td>53.0°C</td></tr> <tr><td>15</td><td>C10</td><td>26.1°C</td><td>54.8°C</td></tr> <tr><td>16</td><td>LF2</td><td>45.6°C</td><td>68.7°C</td></tr> <tr><td>17</td><td>C8</td><td>38.2°C</td><td>56.4°C</td></tr> <tr><td>18</td><td>RY1</td><td>31.6°C</td><td>58.5°C</td></tr> <tr><td>19</td><td>C488</td><td>56.6°C</td><td>81.5°C</td></tr> <tr><td>20</td><td>C435</td><td>50.6°C</td><td>84.3°C</td></tr> <tr><td>21</td><td>C438</td><td>52.6°C</td><td>82.7°C</td></tr> <tr><td>22</td><td>C600</td><td>34.8°C</td><td>62.9°C</td></tr> <tr><td>23</td><td>Q403</td><td>62.2°C</td><td>85.4°C</td></tr> <tr><td>24</td><td>Q404</td><td>64.1°C</td><td>85.7°C</td></tr> <tr><td>25</td><td>Q400</td><td>65.2°C</td><td>86.1°C</td></tr> <tr><td>26</td><td>T402</td><td>43.3°C</td><td>74.7°C</td></tr> <tr><td>27</td><td>T1 core</td><td>52.0°C</td><td>81.8°C</td></tr> <tr><td>28</td><td>T1 wire</td><td>78.7°C</td><td>101.3°C</td></tr> <tr><td>29</td><td>T2 core</td><td>63.1°C</td><td>77.2°C</td></tr> <tr><td>30</td><td>T2 wire</td><td>73.4°C</td><td>98.4°C</td></tr> <tr><td>31</td><td>L40 core</td><td>57.5°C</td><td>84.8°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 25°C	HIGH AMBIENT Ta= 50°C	1	C110	33.0°C	55.4°C	2	D162	79.7°C	97.0°C	3	D163	75.6°C	91.4°C	4	L5	39.0°C	64.7°C	5	Q160	74.5°C	88.6°C	6	Q161	71.8°C	82.2°C	7	Q162	90.7°C	104.5°C	8	Q163	81.7°C	102.1°C	9	Q164	85.7°C	103.7°C	10	Q165	83.7°C	95.3°C	11	RG2	32.2°C	59.8°C	12	U301	37.4°C	61.8°C	13	T221	32.0°C	58.1°C	14	C173	29.7°C	53.0°C	15	C10	26.1°C	54.8°C	16	LF2	45.6°C	68.7°C	17	C8	38.2°C	56.4°C	18	RY1	31.6°C	58.5°C	19	C488	56.6°C	81.5°C	20	C435	50.6°C	84.3°C	21	C438	52.6°C	82.7°C	22	C600	34.8°C	62.9°C	23	Q403	62.2°C	85.4°C	24	Q404	64.1°C	85.7°C	25	Q400	65.2°C	86.1°C	26	T402	43.3°C	74.7°C	27	T1 core	52.0°C	81.8°C	28	T1 wire	78.7°C	101.3°C	29	T2 core	63.1°C	77.2°C	30	T2 wire	73.4°C	98.4°C	31	L40 core	57.5°C	84.8°C
NO	Position	ROOM AMBIENT Ta= 25°C	HIGH AMBIENT Ta= 50°C																																																																																																																																	
1	C110	33.0°C	55.4°C																																																																																																																																	
2	D162	79.7°C	97.0°C																																																																																																																																	
3	D163	75.6°C	91.4°C																																																																																																																																	
4	L5	39.0°C	64.7°C																																																																																																																																	
5	Q160	74.5°C	88.6°C																																																																																																																																	
6	Q161	71.8°C	82.2°C																																																																																																																																	
7	Q162	90.7°C	104.5°C																																																																																																																																	
8	Q163	81.7°C	102.1°C																																																																																																																																	
9	Q164	85.7°C	103.7°C																																																																																																																																	
10	Q165	83.7°C	95.3°C																																																																																																																																	
11	RG2	32.2°C	59.8°C																																																																																																																																	
12	U301	37.4°C	61.8°C																																																																																																																																	
13	T221	32.0°C	58.1°C																																																																																																																																	
14	C173	29.7°C	53.0°C																																																																																																																																	
15	C10	26.1°C	54.8°C																																																																																																																																	
16	LF2	45.6°C	68.7°C																																																																																																																																	
17	C8	38.2°C	56.4°C																																																																																																																																	
18	RY1	31.6°C	58.5°C																																																																																																																																	
19	C488	56.6°C	81.5°C																																																																																																																																	
20	C435	50.6°C	84.3°C																																																																																																																																	
21	C438	52.6°C	82.7°C																																																																																																																																	
22	C600	34.8°C	62.9°C																																																																																																																																	
23	Q403	62.2°C	85.4°C																																																																																																																																	
24	Q404	64.1°C	85.7°C																																																																																																																																	
25	Q400	65.2°C	86.1°C																																																																																																																																	
26	T402	43.3°C	74.7°C																																																																																																																																	
27	T1 core	52.0°C	81.8°C																																																																																																																																	
28	T1 wire	78.7°C	101.3°C																																																																																																																																	
29	T2 core	63.1°C	77.2°C																																																																																																																																	
30	T2 wire	73.4°C	98.4°C																																																																																																																																	
31	L40 core	57.5°C	84.8°C																																																																																																																																	

			32	L40 wire	49.5°C	90.8°C
			33	D610	81.0°C	101.6°C
			34	D614	79.7°C	99.3°C
			35	D618	52.5°C	98.1°C
			36	D619	83.1°C	77.9°C
			37	RT61	38.7°C	64.4°C
			38	RT64	47.6°C	77.7°C
			39	RT65	53.5°C	72.9°C
			40	RTH6	42.2°C	60.6°C
			41	RTH7	35.0°C	61.3°C
			42	C643	28.1°C	55.2°C
			43	C635	26.4°C	55.1°C
			44	C518	27.2°C	50.1°C
			45	U504	27.8°C	50.6°C
			46	T900	33.0°C	54.3°C
			47	T901	30.9°C	51.3°C
			48	Q930	36.4°C	56.7°C
			49	D951	43.2°C	65.0°C
			50	CK12	29.8°C	50.1°C
			51	C951	31.6°C	52.3°C
			52	C439	40.1°C	62.3°C
			53	C440	44.3°C	66.7°C
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR ( MIN )	I/P : 400 VAC O/P : 101%LOAD Ta : 25°C		TEST : OK	
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 530VAC/340VAC O/P : 100 %LOAD Ta= -35°C		TEST : OK	
4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C/95 %R.H NO DAMAGE	I/P : 540 VAC O/P : FULL LOAD Ta= 50°C HUMIDITY= 95 %R.H		TEST : OK	
5	TEMPERATURE COEFFICIENT	± 0.03 %/°C(0~50°C)	I/P : 400 VAC O/P : FULL LOAD		± 0.004 %/°C(0~50°C)	
6	STORAGE TEMPERATURE TEST	-40~85°C	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC			
7	THERMAL SHOCK TEST	-30~50°C	1. Thermal shock Temperature : -35°C~ +55°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 15cycle:380V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:380V/ FULL LOAD Burn In Test			





8	VIBRATION TEST	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 3G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C
9	CAPACITOR LIFE CYCLE	SUPPOSE C643 IS THE MOST CRITICAL COMPONENT (1) I/P : 400VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 400VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 400VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 400VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME	(1) 1255888HRS (2) 190611HRS (3) 343879HRS (4) 509875HRS
10	MTBF	Conducted by Parts Stress Analysis Prediction 281.2K hrs min. Telcordia SR-332 (Bellcore) ; 28K hrs min. MIL-HDBK-217F (25°C)	
11	Ongoing Reliability Test	I/P : 380VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 50,000 hours	

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	DANIEL GAO	SANFORD SU	VINCENT TSENG

2020.10.1 TAG-QA-009