



■ Features

- Supporting connection to fuel generators
- Ultra-wide input voltage range: 110V to 300Vac
- Input power factor ≥ 0.99
- Input current harmonic distortion $<4\%$
- Output power factor of 1
- 50Hz/60Hz frequency conversion mode
- Emergency power-off function (EPO)
- USB/RS-232 communication interfaces
- LCD display panel
- Intelligent charging mode, adjustable charging current
- 3-year warranty

■ Applications

- Data center
- Financial institution
- Smart Buildings
- Industrial automation

■ Global Trade Item Identifier


- MW Search: <http://www.meanwell.com.cn/serviceGTIN.aspx>

■ Description

ES-SU10K is a 10KVA online UPS power supply, providing rack type and tower type two appearance structures, using advanced digital control technology, combined with high integrated circuits and optimized design, enhance anti-interference ability, and ensure stable performance. The product has a full load efficiency of up to 95%, an input power factor of over 0.99, and a current harmonic of less than 4%, which can effectively prevent additional energy loss and reduce grid pollution. Its ultra-wide voltage input range is compatible with unstable power grids and fuel generators, which can easily cope with harsh power environments, reduce the need for frequent switching to battery power, and accurately match the needs of highly sensitive loads such as servers and medical equipment. In addition, the product has built-in EPO emergency power-off function and USB/RS-232 dual communication interfaces, which further strengthens the system security and remote control capabilities. It provides efficient, stable and flexible power protection solutions for key scenarios such as data centers, intelligent manufacturing, and communication base stations.

■ Drive Model Encoding

ES - SU10K - TH



Exterior structure (TH: Tower, RH: Rack)

Power

Series Name


Product Categories (ES: Energy Storage category)




Online UPS

ES-SU10K series

Specification	ES-SU10K-TH	ES-SU10K-RH						
INPUT								
Nominal Voltage	110~300Vac±3% at 60% load; 176~300Vac±3% at 100% load							
Frequency Range	46~54Hz/56~64Hz/40~70Hz(in generator mode)							
Power Factor	≥0.99@full load							
THDi	<4%@100%R load							
Battery								
Battery Parameter (N)	N=16-20							
Charging Voltage Range (FV)	12V*N(N=16~20, depended on the parameter of UPS batteries configured.)							
Low-Voltage Protection Point	10.7V*N							
High-Voltage Protection Point	14.4V*N							
Charing Current (CC)	1/2/4/6/8A adjustable, 2A(Default)							
OUTPUT								
Power	10KVA/10KW							
Output Voltage	208/220/230/240Vac							
AC Voltage Regulation	±1%							
Frequency	<table> <tr> <td>AC Mode</td><td>46~54Hz/56~64Hz</td></tr> <tr> <td>Battery Mode</td><td>50/60±0.1Hz</td></tr> </table>	AC Mode	46~54Hz/56~64Hz	Battery Mode	50/60±0.1Hz			
AC Mode	46~54Hz/56~64Hz							
Battery Mode	50/60±0.1Hz							
Waveform	Battery Mode	Pure Sinewave						
Harmonic Distortion	≤1%THD(linear load);≤4%THD(Non-linear Load)							
Transfer Time	<table> <tr> <td>AC to Battery</td><td>0</td></tr> <tr> <td>Online to Bypass</td><td>0</td></tr> </table>	AC to Battery	0	Online to Bypass	0			
AC to Battery	0							
Online to Bypass	0							
Overload	<table> <tr> <td>AC Mode</td><td>100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1 min; >150%, immediately</td><td>100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1min; >130%, immediately</td></tr> <tr> <td>Battery Mode</td><td>100%-110%, 3min; 110%-130%, 30s; >130%, immediately</td><td></td></tr> </table>	AC Mode	100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1 min; >150%, immediately	100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1min; >130%, immediately	Battery Mode	100%-110%, 3min; 110%-130%, 30s; >130%, immediately		
AC Mode	100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1 min; >150%, immediately	100%-110%, 60 min; 110%-125%, 10 min; 125%-150%, 1min; >130%, immediately						
Battery Mode	100%-110%, 3min; 110%-130%, 30s; >130%, immediately							
Efficiency	<table> <tr> <td>AC Mode</td><td>95%</td></tr> <tr> <td>Battery Mode</td><td>92%</td></tr> </table>	AC Mode	95%	Battery Mode	92%			
AC Mode	95%							
Battery Mode	92%							
SAFETY & EMC								
SAFETY STANDARDS								
EN IEC 62040-1:2019/A1:2023, YD/T1095-2018								
EMC EMISSION								
	Parameter	Standard	Test Level / Note					
	Conducted emission	EN IEC 62040-2:2018	C3					
	Radiated emission	EN IEC 62040-2:2018	C3					
	Harmonic current	EN 61000-3-12:2011	Class A					
	Voltage flicker	EN IEC 61000-3-11:2019	Clause 5					
EMC IMMUNITY								
	Parameter	Standard	Test Level / Note					
	ESD	IEC 61000-4-2:2008	Level 3, 4KV air ; Level 2: 4KV contact					
	RS	IEC 61000-4-3:2006	Level 3					
	EFT	IEC 61000-4-4:2012	Level 4,1KV					
	Surge	IEC 61000-4-5:2014	Level 4,1KV/Line-Line 2KV/Line-Earth					
	Conducted	IEC 61000-4-6:2013	Level 3					
	Magnetic Field	IEC 61000-4-8:2009	Level 4					
	Voltage Dips and Interruptions	EN IEC 61000-4-11:2020	100% residual voltage for 0.5cycle; 100% residual voltage for 1cycle; 100% residual voltage for 250cycle; 30% residual voltage for 25cycle					
OTHER								
Communication interface	RS232/USB							
Phase	1 phase in/1 phase out							
Display	LCD							
Operating temperature	0~40°C							
Humidity	20-90% relative humidity(non-condensing)							
Elevation	1000m							
Struture	Tower	Rack						
Weight	15kg	12.1kg						
Size	404*190*337mm	515*438*88mm(2U)						
NOTE								
1. Derate capacity to 60% of capacity in CVCF mode 2. Derate capacity to 90% when the output voltage is adjusted to 208VAC or parallel system is operated 3. When using 16 pieces of balteres.the outpu power factor wil be derated to 0.8. 4. fuing 18 or 19 pieces of batenes. the outout power factor wil be derated to 0.9 5. if the UPS is installed or used in a place where the altitude is above than 1000m. the outout power must be derated one percent per 100m. 6.The battery parameter setting is introduced in Sections 3-6 and 18 of the Reference Manual.								

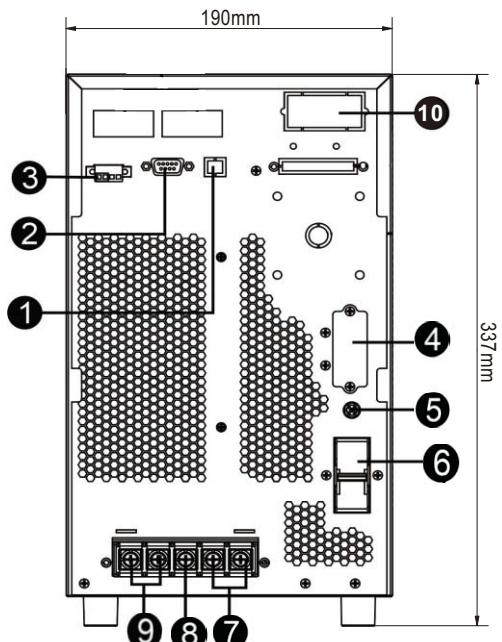■ Mechanism Dimension**■ ES-SU10K-TH**


(404*190*337mm)

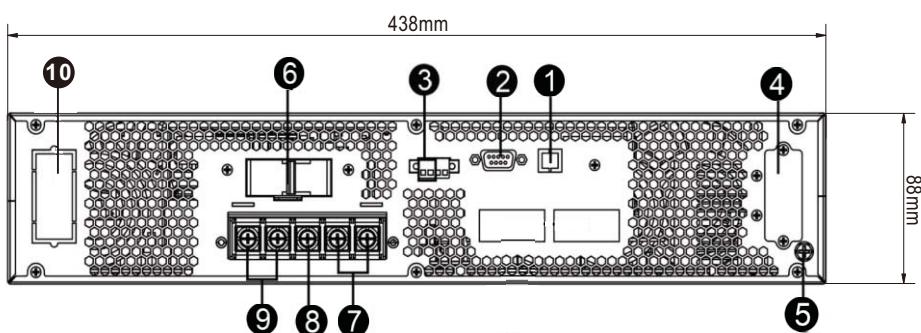■ ES-SU10K-RH

(515*438*88mm)

- 1: USB communication port
- 2: RS-232 communication port
- 3: Emergency shutdown function interface (If the EPO terminal is open-circuited, the UPS output will be turned off.
This terminal is short-circuited at the factory.)
- 4: External battery connector
- 5: External battery grounding screws
- 6: Line input circuit breaker/switch
- 7: AC input terminal
- 8: Ground terminal
- 9: Output terminal
- 10: Control Card Slot

Remove the terminal block protective cover on the back panel of the UPS. Next, follow the following terminal block diagram to wiring the wire: (When wiring, connect the ground wire first.) When removing the wiring, leave the groundwire for last!

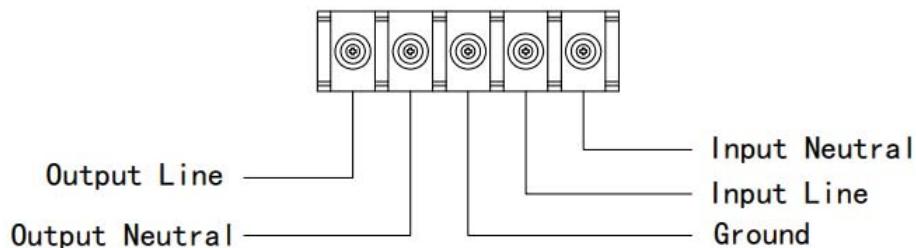


Model	Cabling Specifications(mm^2)			
	Input	Output	Battery	Ground
ES-SU10K	10	10	10	10


Note 1: Cables must use 10mm^2 or higher in order to balance safety and efficiency.

Note 2: The color of the wire rod must comply with the local electrical regulations

Connecting the battery: When connecting the battery box, be sure to confirm that the polarity of the battery is correctly connected.

Required specifications of circuit breaker: voltage $\geq 1.25 \times$ battery voltage / number of groups, current $\geq 50\text{A}$
 Please select the appropriate battery size and connection quantity according to the needs of the birth time and the specifications of the UPS.

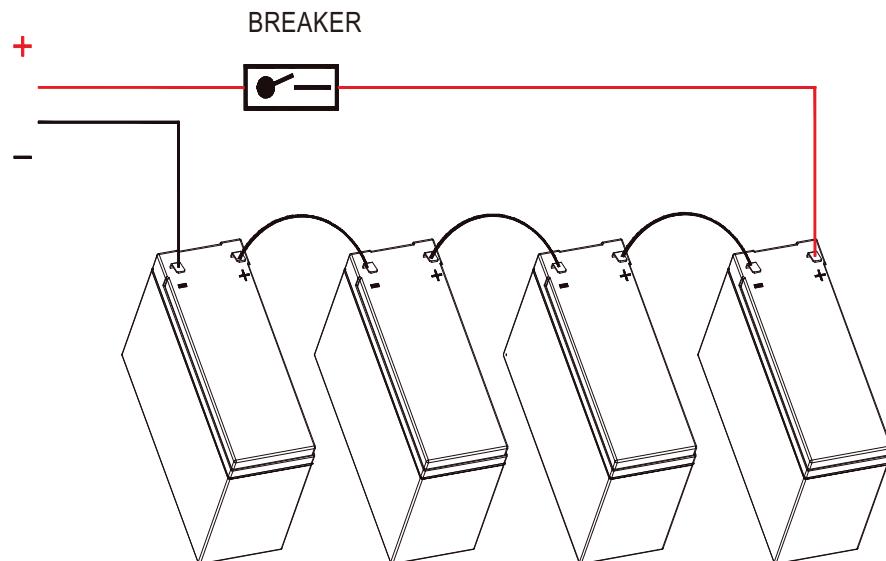

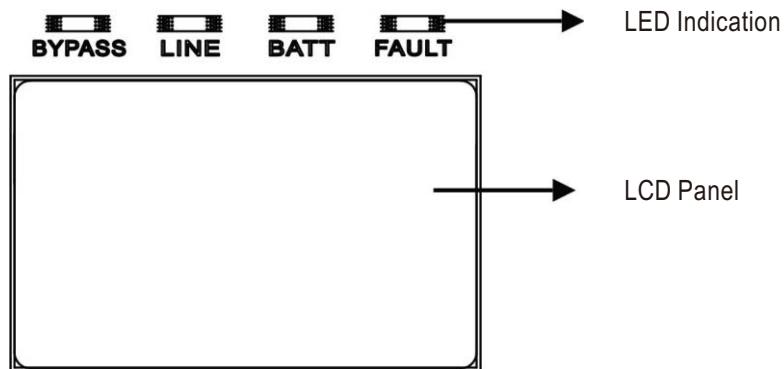
■ LED Indication and LCD Panel

There are 4 LEDs on the front panel to show the UPS operating status:

Status (LED)	Bypass	Line	Battery	Fault
UPS Start	●	●	●	●
No Input	○	○	○	○
Bypass Mode	●	○	○	○
AC Mode	○	●	○	○
Battery Mode	○	○	●	○
CVCF Mode	○	●	○	○
Battery Testing	●	●	●	○
ECO Mode	●	●	○	○
Fault	○	○	○	●

Note: ● means that the indicator light is on, and ○ means that the indicator light is off

■ LCD Panel

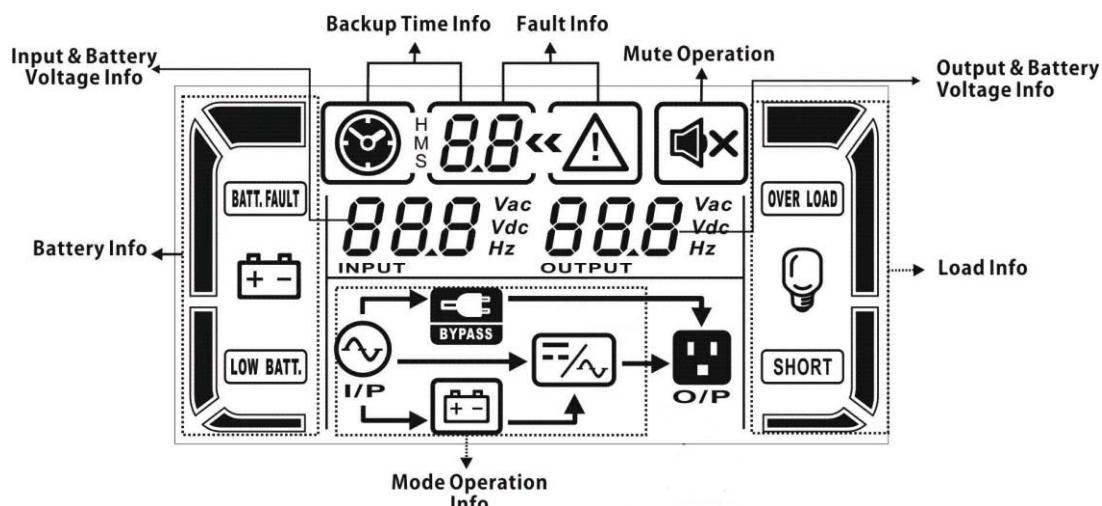

Display	Function
Backup time information	
 88	Indicates battery dicharge time in number H:hours, M: minutes, S: seconds
Fault information	
 88	Indicates that the warning and fault occurs
 88	Indicates the fault codes
Mute operation	
 88	Indicates that the UPS alarm is disabled
Output & Input & Battery voltage information	
888 Vac Vdc Hz	Indicates the output voltage, frequency or battery voltage Vac: output voltage, Vdc: battery voltage, Hz: frequency
Load information	
 88	Indicates the load level by 0-25%、26-50%、51-75%、and 76-100%。
OVER LOAD	Indicates overload
SHORT	Indicates the load or the output is short
Mode operation information	
 88	Indicates the Ups connects to the mains.
 88	Indicates the battery is working
 88	Indicates the bypass circuit is working
 88	Indicates the ECO mode is enabled
 88	Indicates the Inverter circuit is working
 88	Indicates the output is working

Battery information	
	Indicates the output is working. Indicates the Battery capacity by 0-25%, 26-50%, 51-75%, and 76-100%
	Indicates the battery is not connected
	Indicates low battery level and low battery voltage
Input & Battery voltage information	
	Indicates the input voltage or frequency or battery voltage Vac: Input voltage, Vdc: battery voltage, Hz: input frequency

■ Audible Alarm

Description	Buzzer status	Muted
UPS status		
Bypass mode	Beeping once every 2 minutes	Yes
Battery mode	Beeping once every 4 seconds	
Fault mode	Beeping continuously	
Warning		
Overload	Beeping twice every second	Yes
Others	Beeping once every second	
Fault		
All	Beeping continuously	Yes

■ Abbreviation Meaning in LCD Display

Abbreviation	Display content	Meaning
ENA		Enable
DIS		Disable
ATO		Auto
BAT		Battery
NCF		Normal mode(not CVCF mode)
CF		CVCF mode
SUB		Subtract
ADD		Add
ON		On
OFF		Off
FBD		Not allowed
OPN		Allow
RES		Reserved
OP.V		Output voltage
PAR		Parallel

■ Accessories List

	Object	Number
1	User Manual	1
2	Monitoring software CD-ROMs	1
3	USB cable	1
4	Computer cables	1
5	Battery cable	1
6	Vertical tripod (only Rack)	2
7	Cabinet mounting brackets (only Rack)	2

■ Optional accessories(Need to be ordered separately)

Model	Item	Description	Function
PSWG-ES-SU-SNMP		SNMP Communication Card	<ul style="list-style-type: none"> Multiple UPS systems can be controlled and monitored via the RJ-45 interface. UPS data (voltage, frequency, load level, battery capacity) is displayed in a real-time and dynamic graphical interface. Warning notifications can be sent via audible and visual alarms, broadcasts, mobile messengers, SNMP traps, and emails. Historical data can be stored in the database of the terminal computer. Simple firmware update. It has the functions of password security protection and remote access management.
PSWG-ES-SU-MOD		Modbus Card	<ul style="list-style-type: none"> Multiple UPS systems can be controlled and monitored via the RS-485 interface. It supports the MODBUS RTU communication protocol. Data reading and writing operations can be performed via registers. It provides surge protection.
PSWG-ES-SU-AS9P		Relay Card(9-Pin wire-locking terminal)	<ul style="list-style-type: none"> It provides contact signals to enable remote monitoring of the UPS. To meet different environmental requirements, the signal status (open circuit or closed circuit) of the dry contacts can be set via jumpers.
PSWG-ES-SU-ASDB9		Relay Card(DB9 connector)	